


GSF-2 PACKAGE
GARDEN SUITE
FURNACE- FIRE
ALARM OPTION

FOR
REFERENCE
ONLY




STUDIO GARDEN SUITE

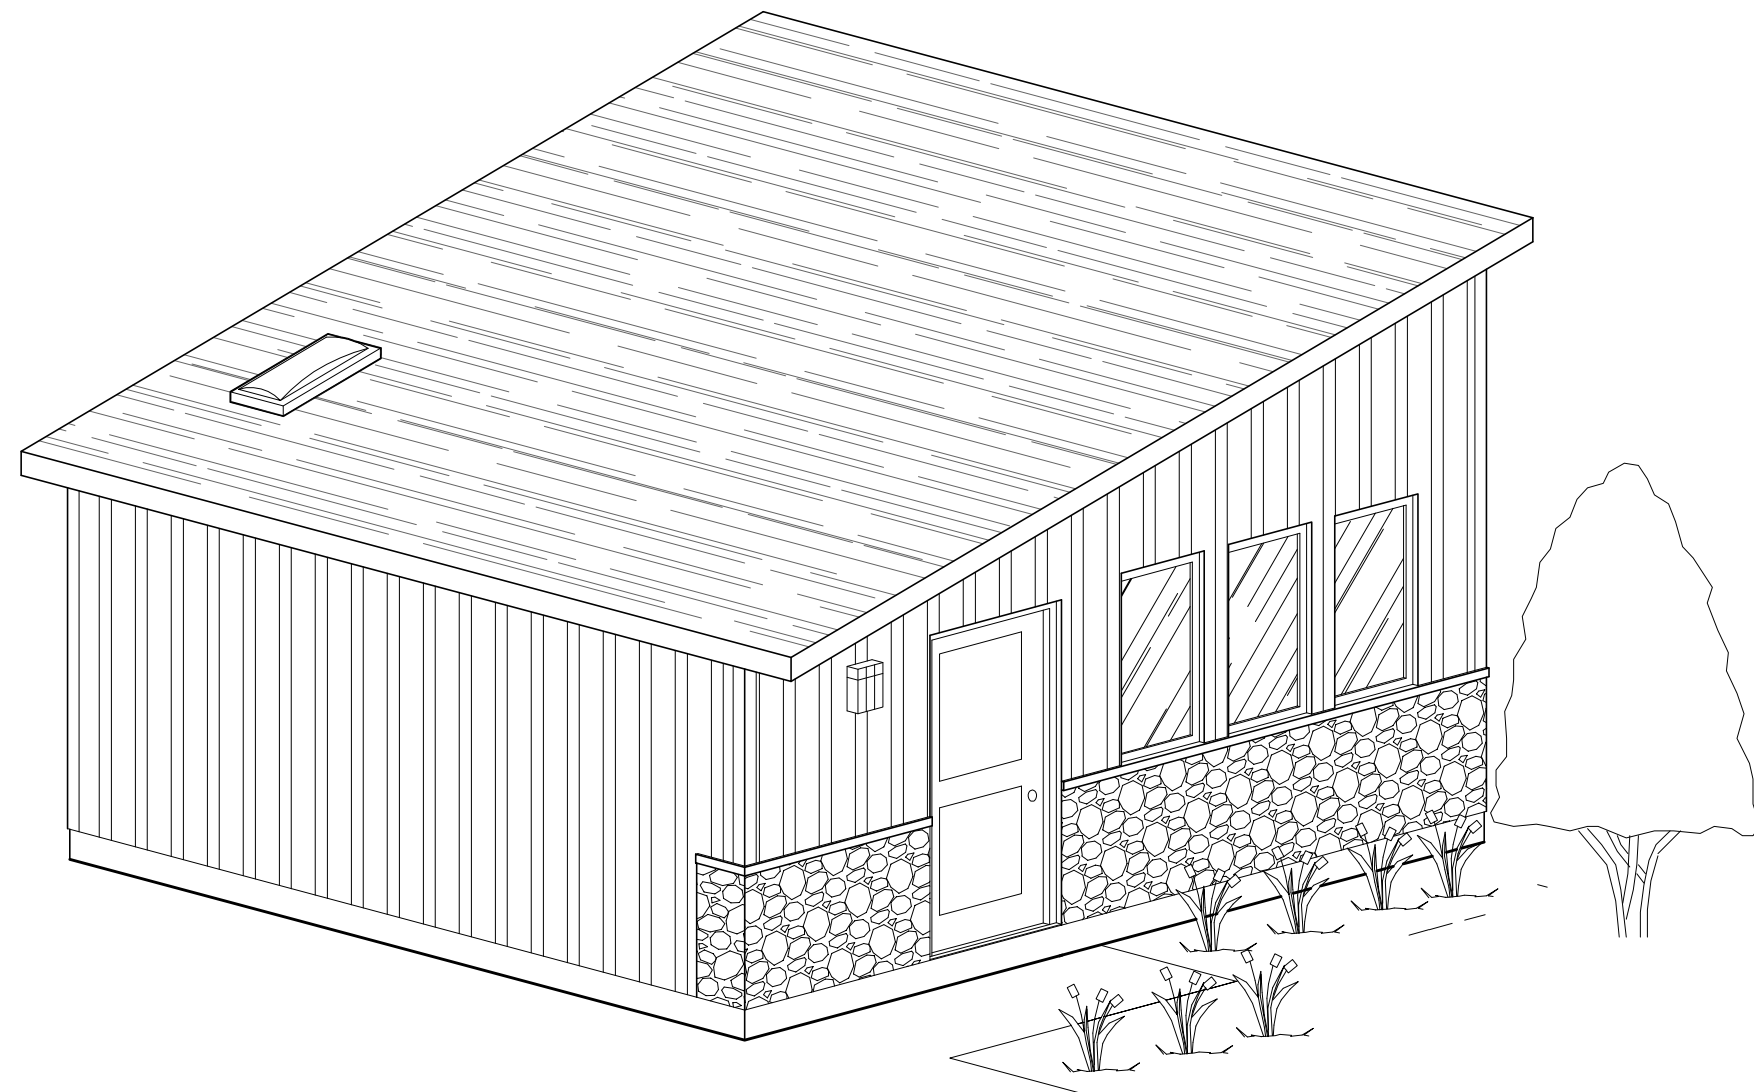

CITY OF TORONTO
TORONTO BUILDING DIVISION
DEVELOPMENT AND GROWTH
SERVICES
100 QUEEN ST W
TORONTO, ON, M5H 2N2

GSF-2 PACKAGE
GARDEN SUITE
FURNACE- FIRE
ALARM OPTION

FOR
REFERENCE
ONLY

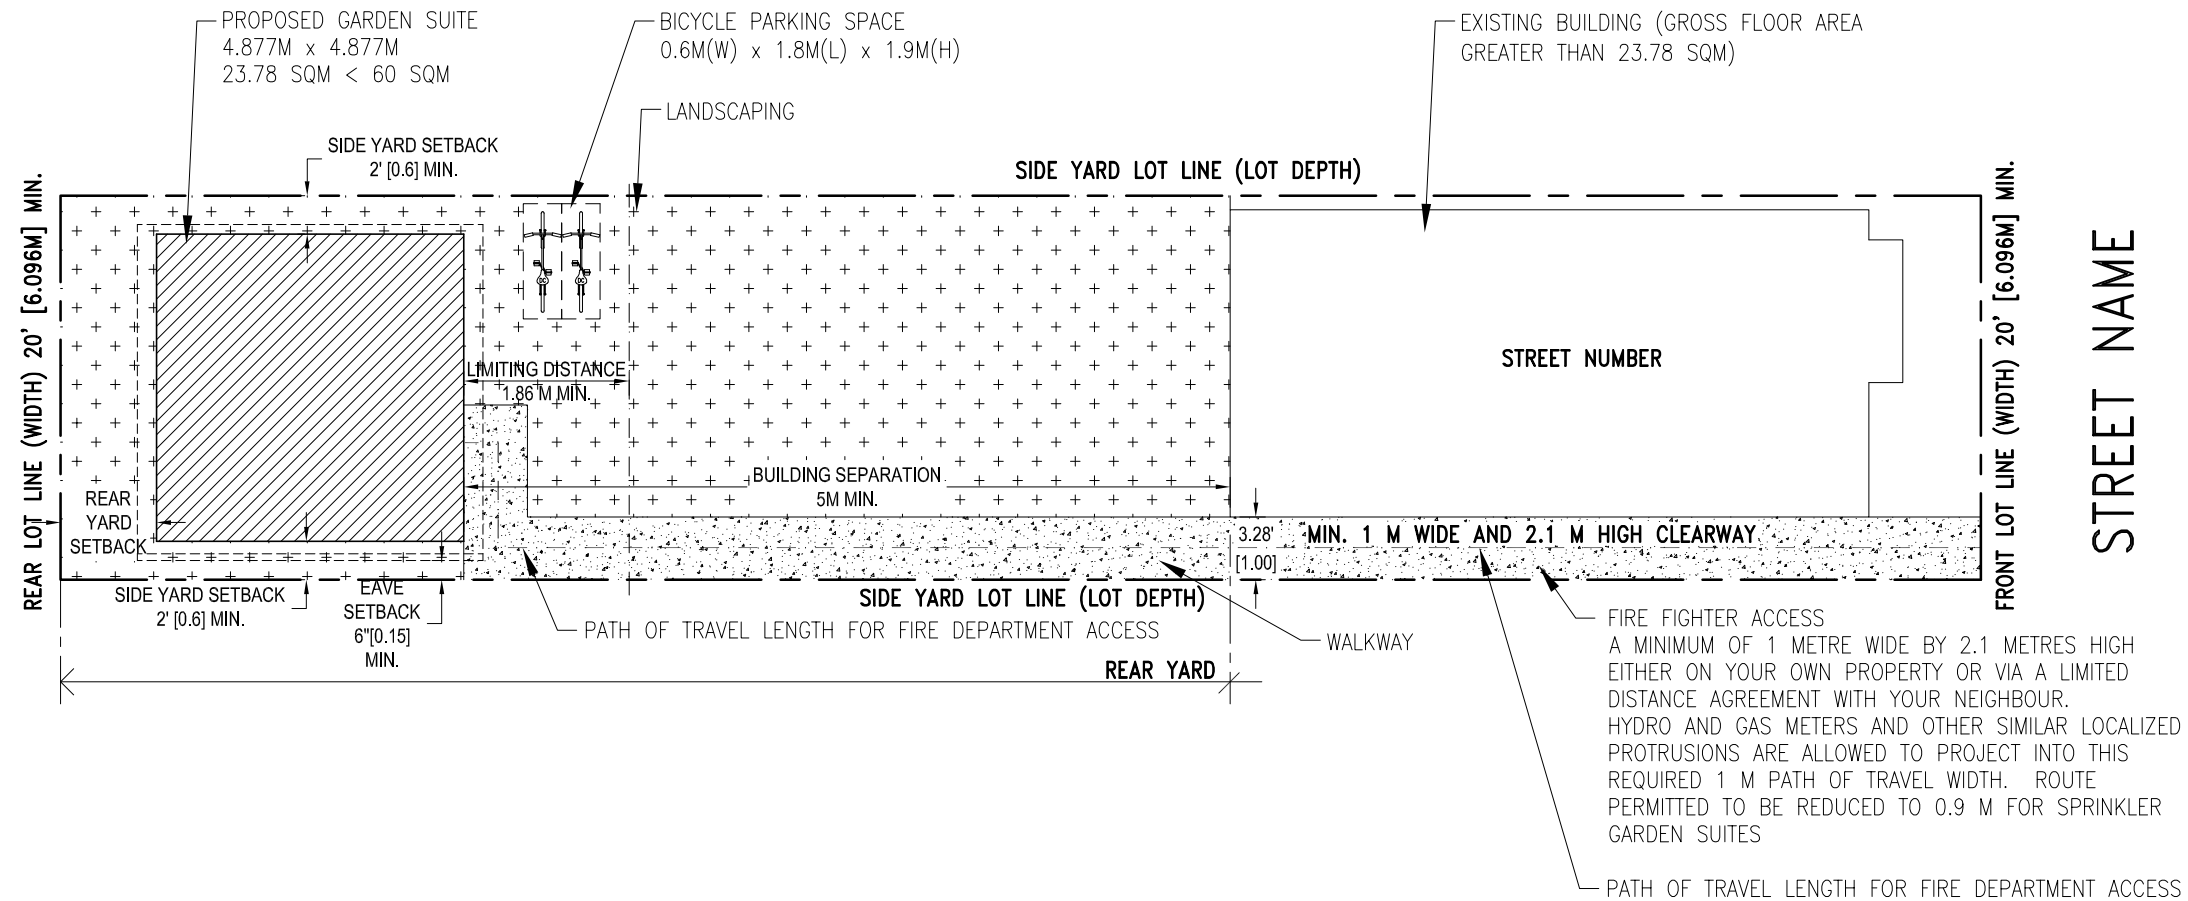

Zoning Bylaw 569-2013 related to Garden Suites (For lots without an apartment building)

- **Landscaping**
150.7.50.10(1)
(A) LOT FRONTAGE OF GREATER THAN 6M REQUIRES MINIMUM OF 50% SOFT LANDSCAPING IN REAR YARD.
(B) LOT FRONTAGE 6M OR LESS REQUIRES 25% OF SOFT LANDSCAPING IN REAR YARD.
- **Rear Yard Setbacks**
150.7.60.20
(2)(A) IF ON A LOT DEPTH GREATER THAN 45.0M, THE GREATER OF 1.5M OR HALF THE HEIGHT OF THE ANCILLARY BUILDING.
(B) IN ALL OTHER CASES 1.5M

(3)(A) IF IT IS ON A THROUGH LOT AND A RESIDENTIAL BUILDING ON AN ADJACENT LOT FRONTS ON THE STREET THAT ABUTS THE REAR LOT LINE OF THE THROUGH LOT THE REQUIRED MINIMUM REAR YARD SETBACK IS EQUAL TO THE REQUIRED MINIMUM FRONT YARD SETBACK FOR THE RESIDENTIAL BUILDING ON THE ADJACENT LOT
(B) IN ALL OTHER CASES 1.5M

(4) IF PARKING PROPOSED SEE 150.7.60.20(4)(A)(B)
- **Lot Coverage**
(Total Floor Area Based on Footprint)
TO COMPLY WITH 150.7.60.70(1)
- **Side Yard Setbacks**
150.7.60.20(5)
(A) IF THE SIDE LOT LINE DOES NOT ABUT A STREET AND THERE ARE OPENINGS THE SETBACK REQUIRED IS THE GREATER OF 1.5M OR 10% OF THE LOT FRONTAGE, TO A MAXIMUM OF 3.0 METRES.
(B) IN ALL OTHER CASES, THE SETBACK REQUIRED IS THE GREATER OF 0.6M OR 10% OF THE LOT FRONTAGE, TO A MAXIMUM OF 3.0 METRES..

150.7.60.20(6)
(A) IF IT IS ON A CORNER LOT AND CONTAINS A PARKING SPACE WITH ACCESS FROM THE CORNER STREET SETBACK REQUIRED IS 6M
(B) IN ALL OTHER CASES THE REQUIRED SIDE YARD SETBACK IS THE GREATER OF THE REQUIRED MINIMUM SIDE YARD SETBACK FOR THE RESIDENTIAL BUILDING ON THE AND AND 1.5M.
- **Separation and Dimensions**
TO COMPLY WITH 150.7.60.30 (1)
- **Heights**
TO COMPLY WITH 150.7.60.40 (1)
- **Floor Area**
TO COMPLY WITH 150.7.60.50 (2)
- **Equipment**
150.7.60.60
(7) WALL MOUNTED EQUIPMENT ON AN ANCILLARY BUILDING CONTAINING A GARDEN SUITE, SUCH AS VENTS, PIPES, UTILITY EQUIPMENT, SATELLITE DISHES, ANTENNAE OR AIR CONDITIONERS, MAY ENCR OACH A MAXIMUM OF 0.6 METRES AS FOLLOWS, IF THE EQUIPMENT IS NO CLOSER TO A LOT LINE THAN 0.3 METRES:
(A) ON A MAIN WALL OF THE ANCILLARY BUILDING, INTO THE MINIMUM BUILDING SETBACKS REQUIRED IN CLAUSE 150.7.60.20; AND
(B) ON THE FRONT MAIN WALL OF THE ANCILLARY BUILDING, INTO THE DISTANCE SEPARATION REQUIRED IN REGULATION 150.7.60.30(1).
- **Bicycle Parking**
150.8.80.1
(2) A MINIMUM OF TWO BICYCLE PARKING SPACES REQUIRED

Length of Path of Travel for Fire Department Access

A MAXIMUM OF 45 METRES IN LENGTH MEASURED FROM THE PUBLIC STREET TO THE ENTRY OF THE LANEWAY SUITE,
-A MAXIMUM OF 90 METRES IN LENGTH MEASURED FROM THE PUBLIC STREET OR A FLANKING STREET THROUGH THE LANEWAY TO THE ENTRY OF THE LANEWAY SUITE ALONG WITH AT LEAST ONE ADDITIONAL FIRE-SAFETY MEASURE, ACCEPTABLE TO THE CITY OF TORONTO.
-A FIRE HYDRANT MUST ALSO BE LOCATED WITHIN 45 METRES OF WHERE A FIREFIGHTING VEHICLE WOULD PARK IN FRONT OF THE SUBJECT PROPERTY OR AT THE INTERSECTION OF A FLANKING STREET AND THE LANEWAY.

Additional Fire-Safety Measures

THERE ARE TWO OPTIONS FOR FIRE-SAFETY MEASURES DEVELOPED BY THE CITY OF TORONTO THAT DESIGNERS MAY INCORPORATE WITHIN THEIR LANEWAY SUITE DESIGNS TO ALLOW THE MAXIMUM TRAVEL DISTANCE TO INCREASE FROM 45 M TO 90 M:

OPTION 1: AUTOMATIC SPRINKLER; EXTERIOR STROBE LIGHT AND SMOKE ALARMS/WARNING SYSTEM


OPTION 2: INCREASED FIRE PROTECTION MATERIALS AND BUILDING METHODS; EXTERIOR STROBE LIGHT; AND SMOKE ALARMS/WARNING SYSTEM.

SITE PLAN

1	AS PER DIVISION COMMENTS	07/2025
NO.	REVISION	DATE
TITLE: STUDIO GARDEN SUITE PRE-APPROVED PLANS		
DATE:	MARCH 2025	DRAWING NO.:
SCALE:	1"=10'-0"	A1




CITY OF TORONTO
TORONTO BUILDING DIVISION
DEVELOPMENT AND GROWTH
SERVICES
100 QUEEN ST W
TORONTO, ON, M5H 2N2

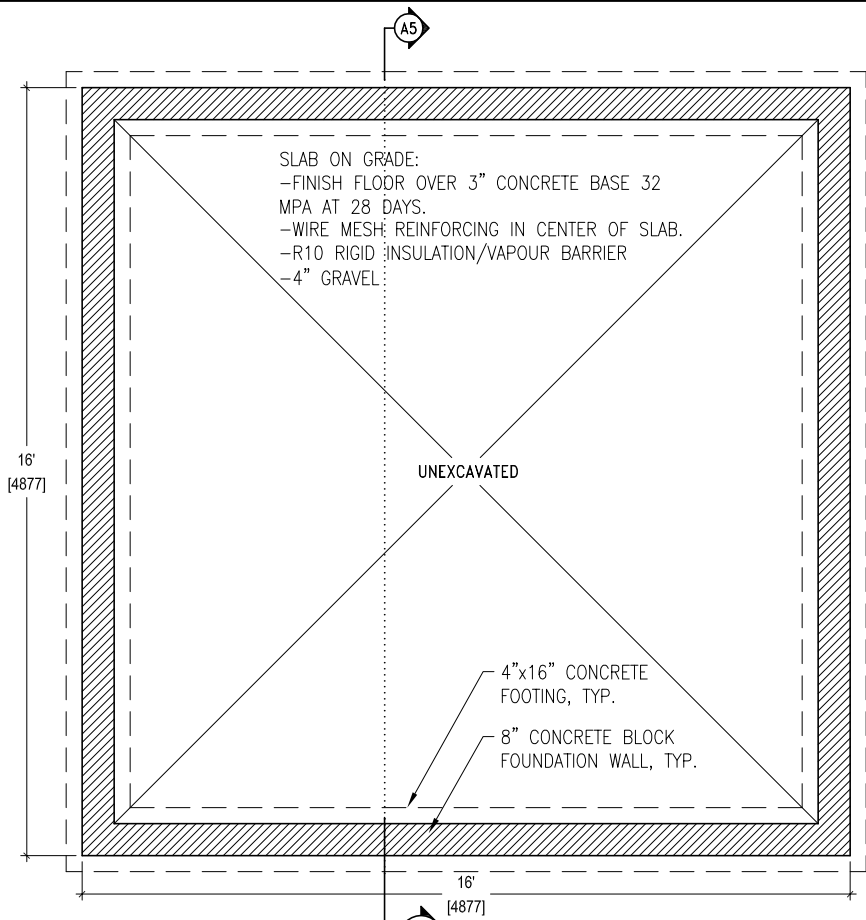


FOUNDATION PLAN

1
A2

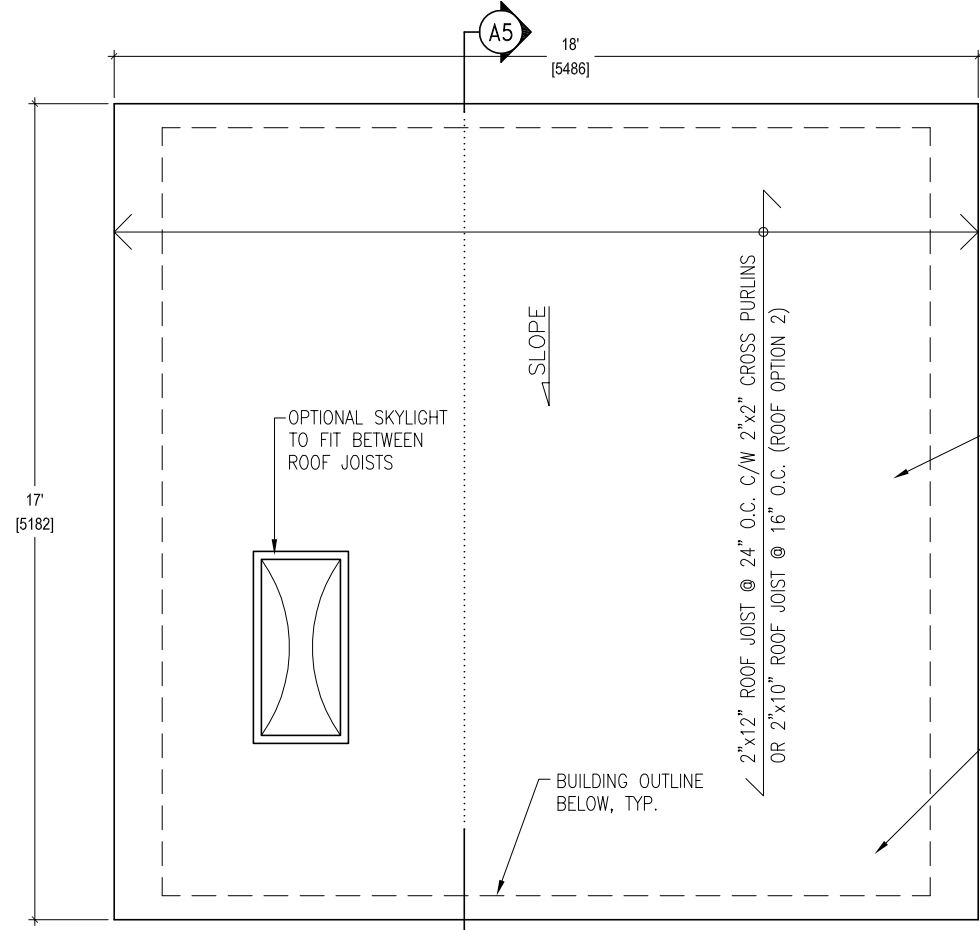


ROOF PLAN

3
A2

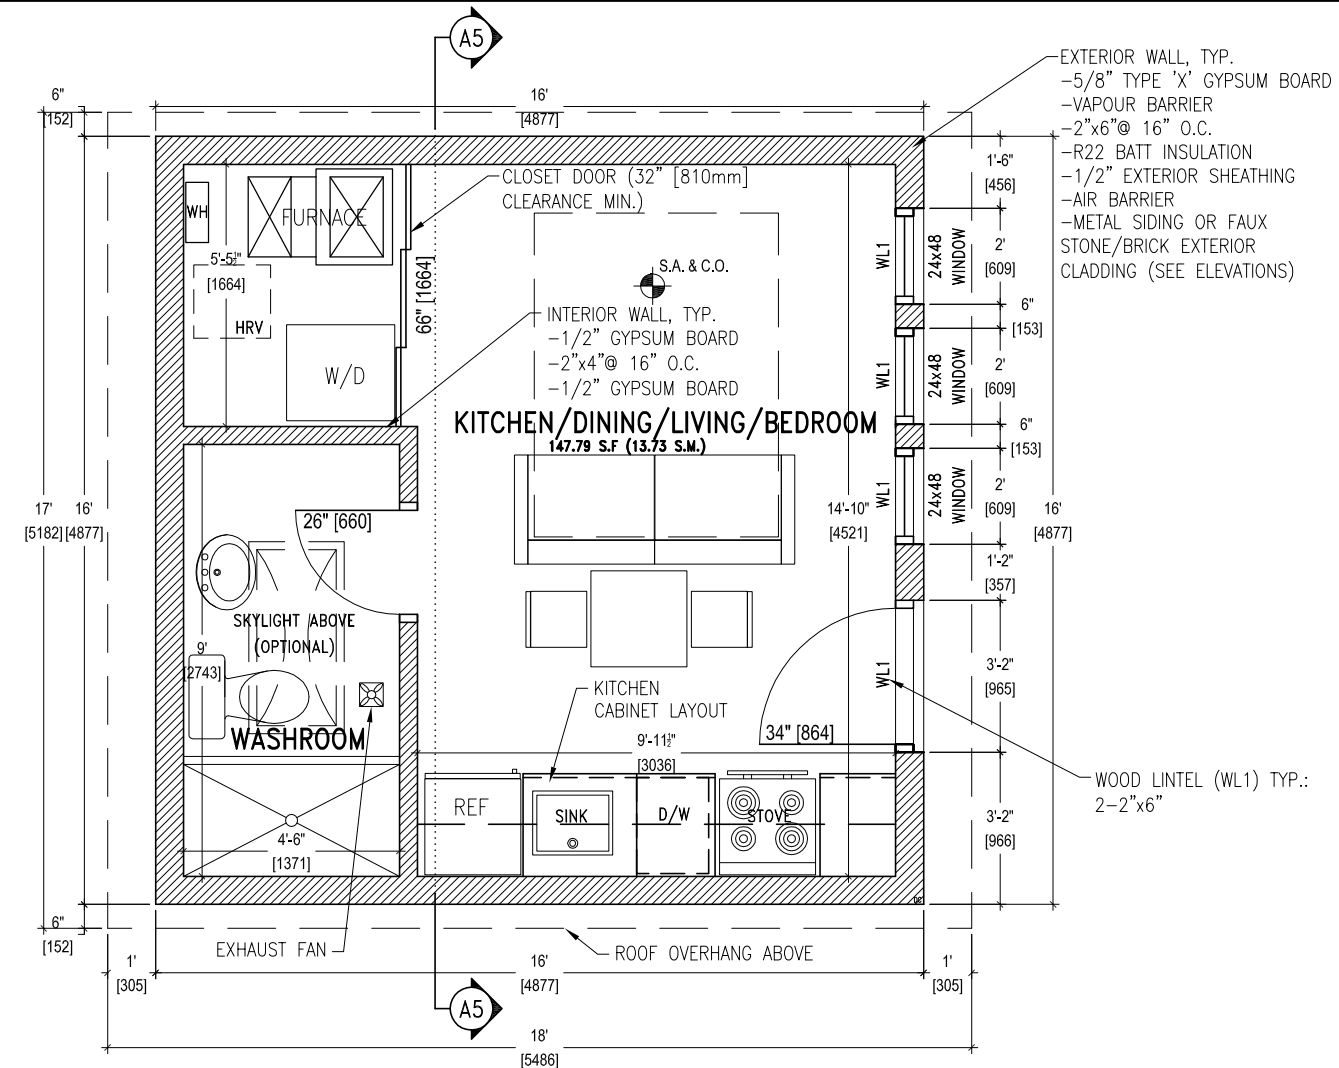

FLOOR PLAN

2
A2

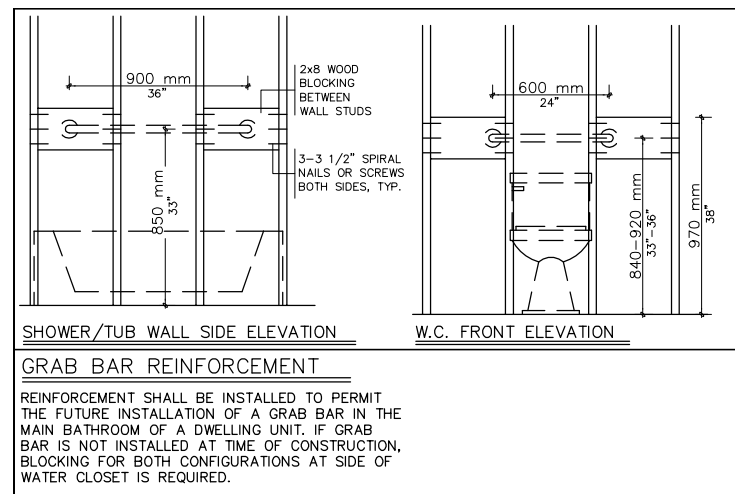

GSF-2 PACKAGE
 GARDEN SUITE
 FURNACE- FIRE
 ALARM OPTION

FOR
 REFERENCE
 ONLY

FOUNDATION, FLOOR
 AND ROOF PLANS

1	AS PER DIVISION COMMENTS	07/2025
NO.	REVISION	DATE
TITLE: STUDIO GARDEN SUITE PRE-APPROVED PLANS		
DATE:	MARCH 2025	DRAWING NO.:
SCALE:	1/4" = 1'-0"	A2


Toronto

CITY OF TORONTO
 TORONTO BUILDING DIVISION
 DEVELOPMENT AND GROWTH
 SERVICES
 100 QUEEN ST W
 TORONTO, ON, M5H 2N2

GSF-2 PACKAGE
GARDEN SUITE
FURNACE- FIRE
ALARM OPTION

FOR
REFERENCE
ONLY

ELEVATIONS (OPTION 1)

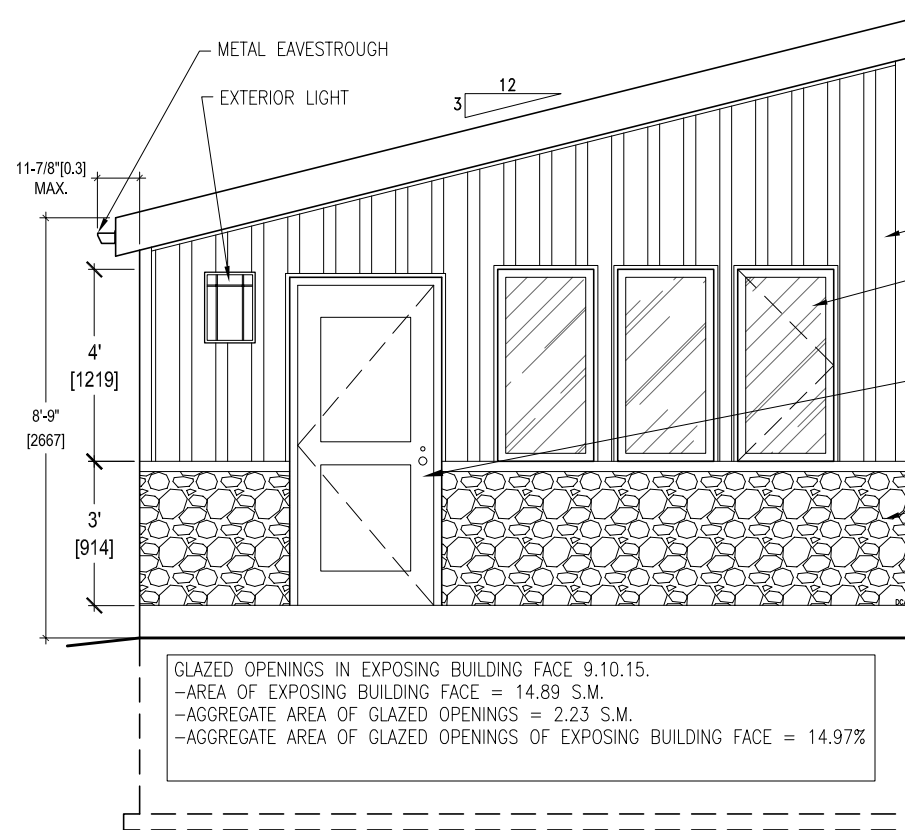

FRONT ELEVATION


1
A3

NOTE: WINDOWS AND DOORS MAY REQUIRE PROTECTED OPENINGS DEPENDING ON SITE CONDITIONS. THIS MUST BE VERIFIED BY TORONTO BUILDING PRIOR TO PERMIT ISSUANCE.

AVERAGE GRADE (THE AVERAGE ELEVATION OF THE EXISTING OR FINISHED GROUND SURFACE, WHICHEVER IS LOWER, AROUND ALL SIDES OF A BUILDING OR STRUCTURE, MEASURED WHERE THE BUILDING OR STRUCTURE MEETS THE GROUND SURFACE, EXCLUDING:
A) THE PART OF THE GROUND ALONG ANY ONE MAIN WALL WHERE THERE IS A PERMITTED VEHICLE ENTRANCE INTO THE BUILDING OR STRUCTURE; AND
B) PARTS OF THE GROUND ALONG EACH MAIN WALL, UP TO A CUMULATIVE MAXIMUM OF 25% OF THE HORIZONTAL LENGTH OF THE MAIN WALL, WHERE THERE ARE PEDESTRIAN ENTRANCES OR WINDOW WELLS.

LEFT SIDE ELEVATION


2
A3

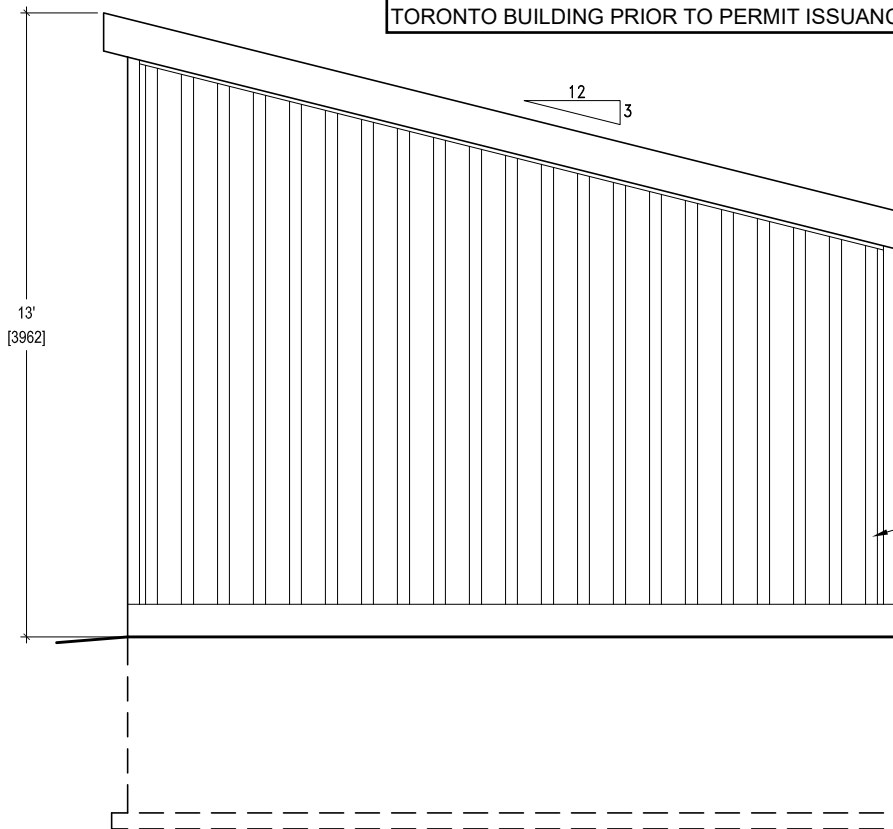

REAR ELEVATION

3
A3

OPTIONAL SKYLIGHT TO FIT BETWEEN ROOF JOISTS
LOW SLOPE ASPHALT SHINGLES
METAL SOFFIT (VENTED) AND FASCIA
METAL SIDING
SLOPE GRADE AWAY

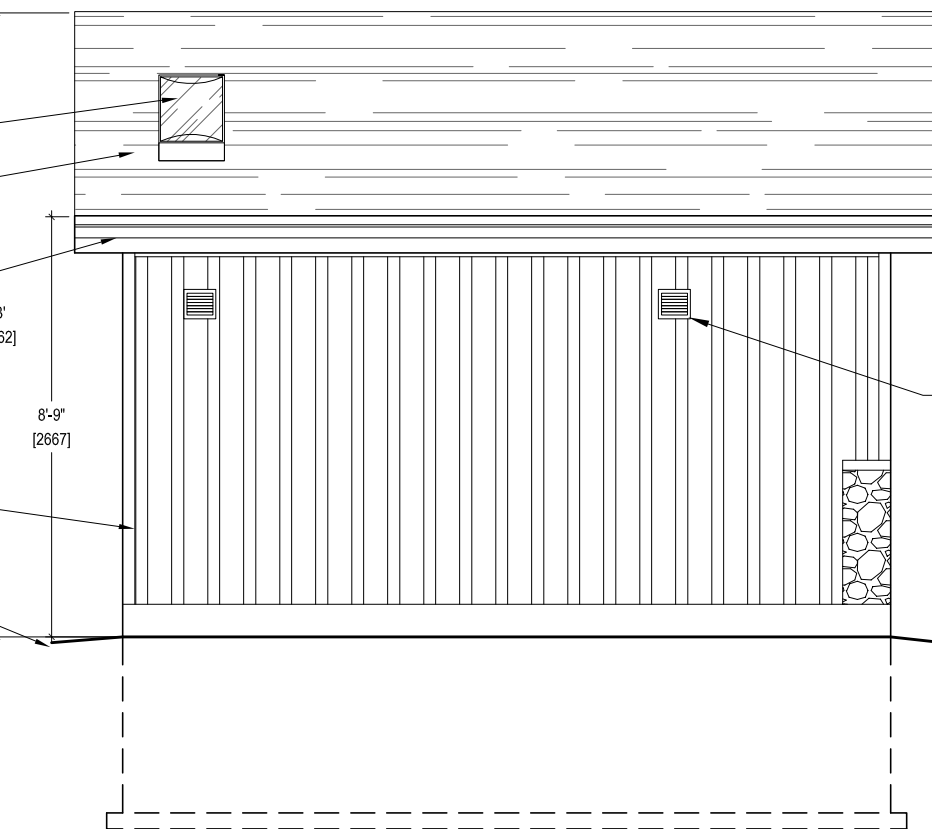

RIGHT SIDE ELEVATION

4
A3

1	AS PER DIVISION COMMENTS	07/2025
NO. REVISION		DATE
TITLE: STUDIO GARDEN SUITE PRE-APPROVED PLANS		
DATE: MARCH 2025	DRAWING NO.:	
SCALE: 1/4" = 1'-0"	A3	




CITY OF TORONTO
TORONTO BUILDING DIVISION
DEVELOPMENT AND GROWTH
SERVICES
100 QUEEN ST W
TORONTO, ON, M5H 2N2

GSF-2 PACKAGE
GARDEN SUITE
FURNACE- FIRE
ALARM OPTION


FOR
REFERENCE
ONLY

ELEVATIONS (OPTION 2)

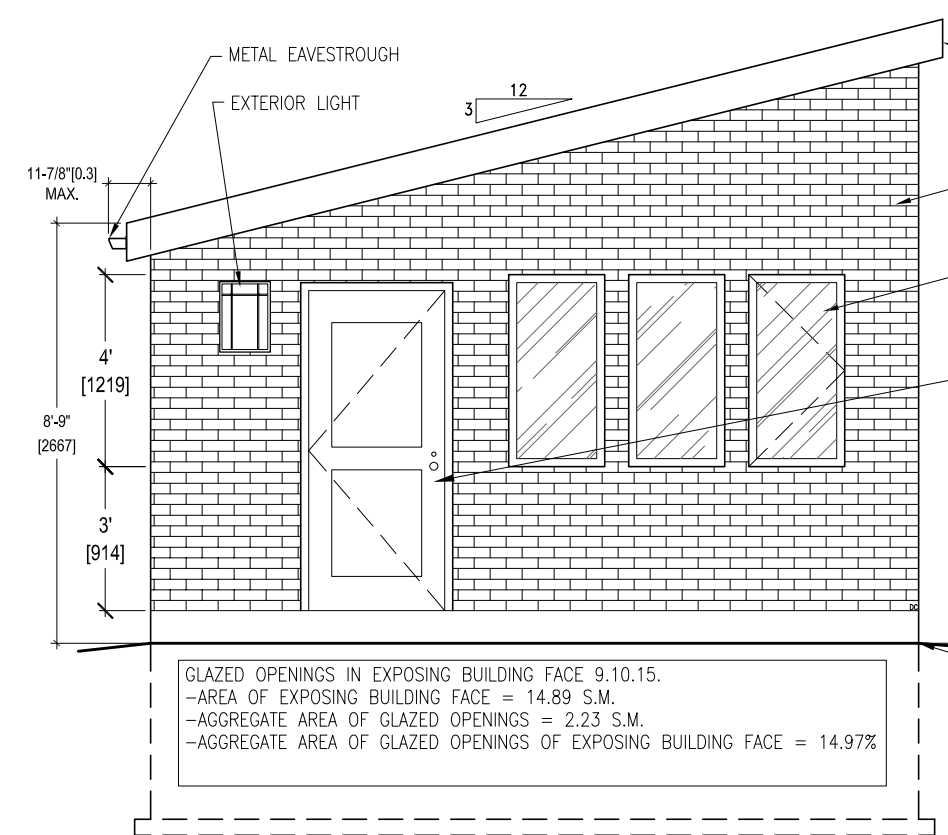

FRONT ELEVATION (FAUX BRICK OPTION)

1
A4

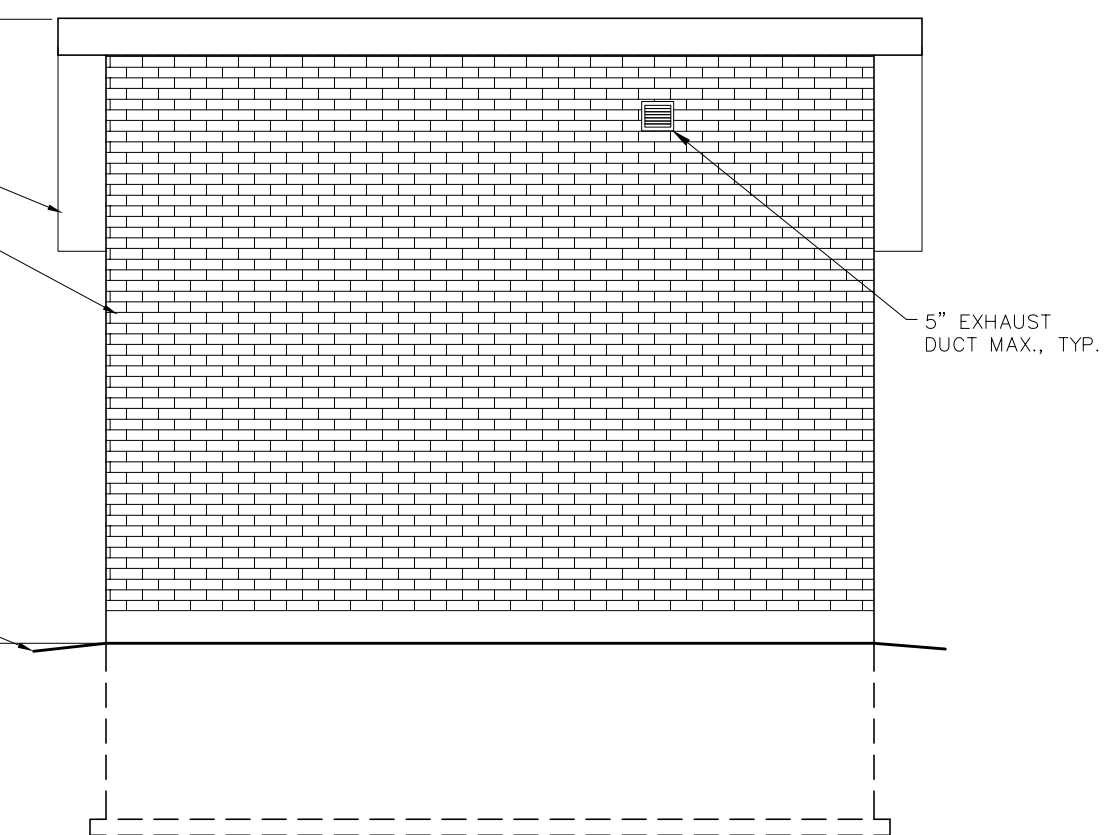


LEFT SIDE ELEVATION (FAUX BRICK OPTION)

2
A4


NOTE: WINDOWS AND DOORS MAY REQUIRE PROTECTED OPENINGS DEPENDING ON SITE CONDITIONS. THIS MUST BE VERIFIED BY TORONTO BUILDING PRIOR TO PERMIT ISSUANCE.

AVERAGE GRADE (THE AVERAGE ELEVATION OF THE EXISTING OR FINISHED GROUND SURFACE, WHICHEVER IS LOWER, AROUND ALL SIDES OF A BUILDING OR STRUCTURE, MEASURED WHERE THE BUILDING OR STRUCTURE MEETS THE GROUND SURFACE, EXCLUDING:
A) THE PART OF THE GROUND ALONG ANY ONE MAIN WALL WHERE THERE IS A PERMITTED VEHICLE ENTRANCE INTO THE BUILDING OR STRUCTURE; AND
B) PARTS OF THE GROUND ALONG EACH MAIN WALL, UP TO A CUMULATIVE MAXIMUM OF 25% OF THE HORIZONTAL LENGTH OF THE MAIN WALL, WHERE THERE ARE PEDESTRIAN ENTRANCES OR WINDOW WELLS.

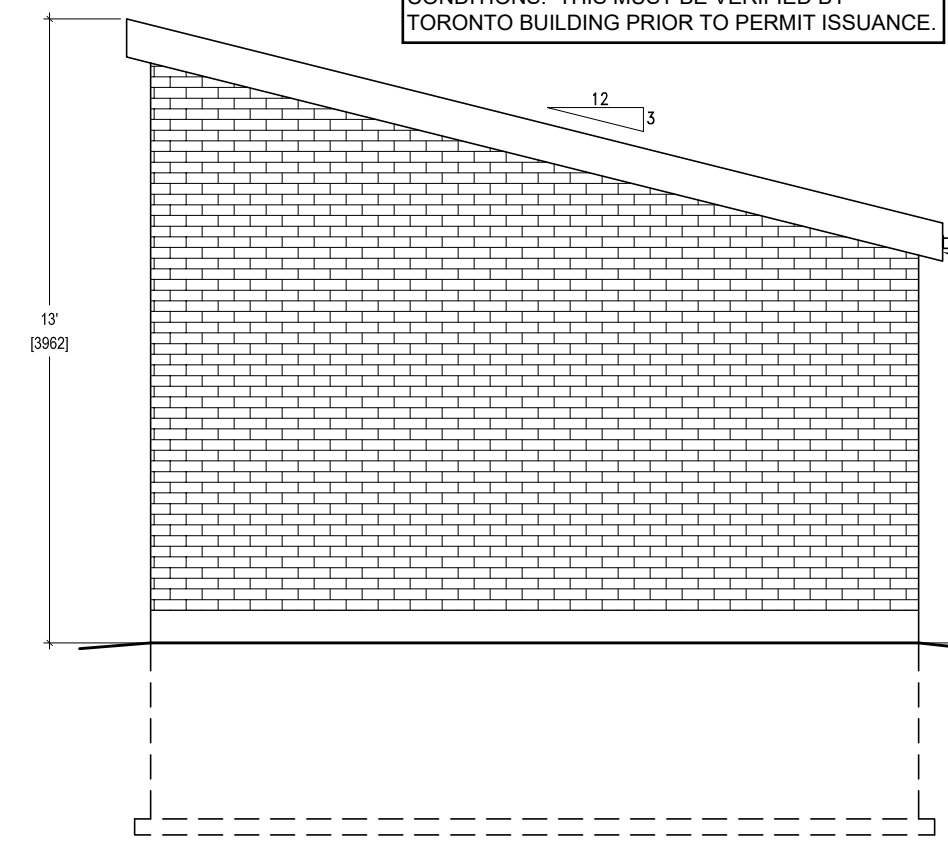

REAR ELEVATION (FAUX BRICK OPTION)

3
A4

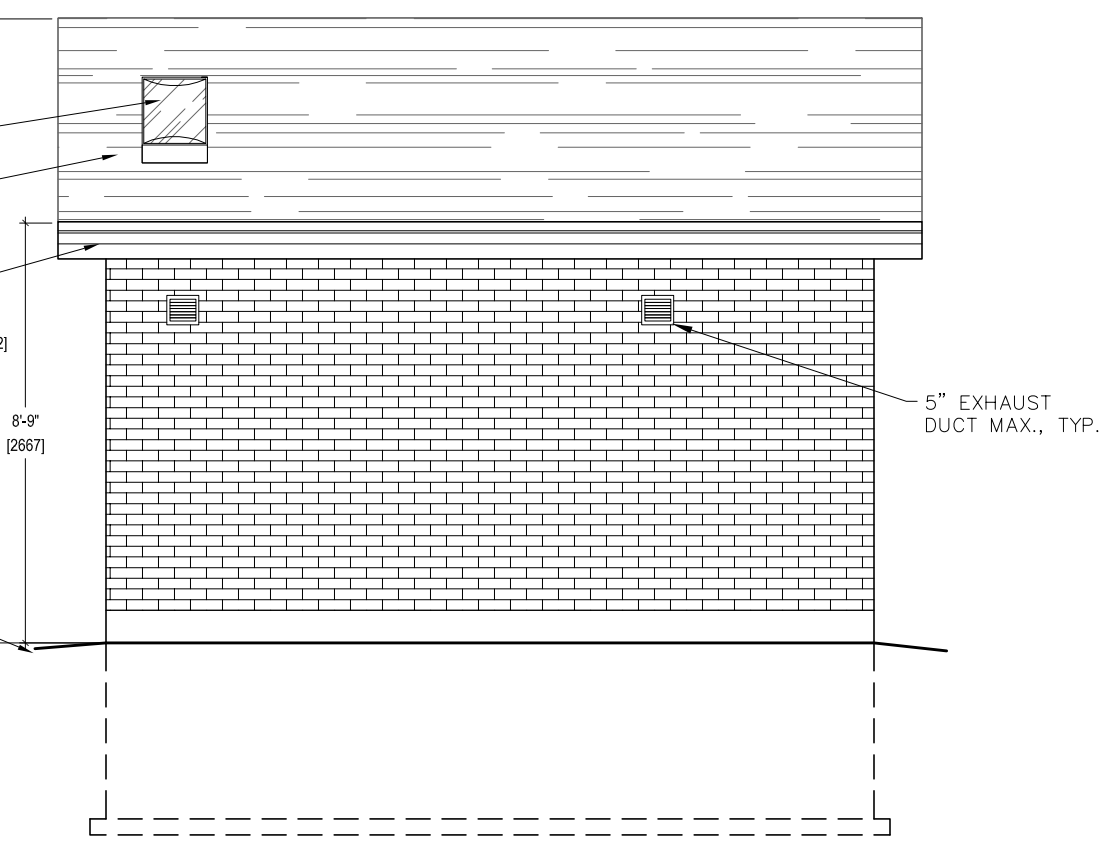

RIGHT SIDE ELEVATION (FAUX BRICK OPTION)

4
A4


1	AS PER DIVISION COMMENTS	07/2025
NO.	REVISION	DATE
TITLE: STUDIO GARDEN SUITE PRE-APPROVED PLANS		
DATE:	MARCH 2025	DRAWING NO.:
SCALE:	1/4" = 1'-0"	A4

Toronto
CITY OF TORONTO
TORONTO BUILDING DIVISION
DEVELOPMENT AND GROWTH
SERVICES
100 QUEEN ST W
TORONTO, ON, M5H 2N2

GSF-2 PACKAGE
GARDEN SUITE
FURNACE- FIRE
ALARM OPTION

FOR
REFERENCE
ONLY

BUILDING SECTION

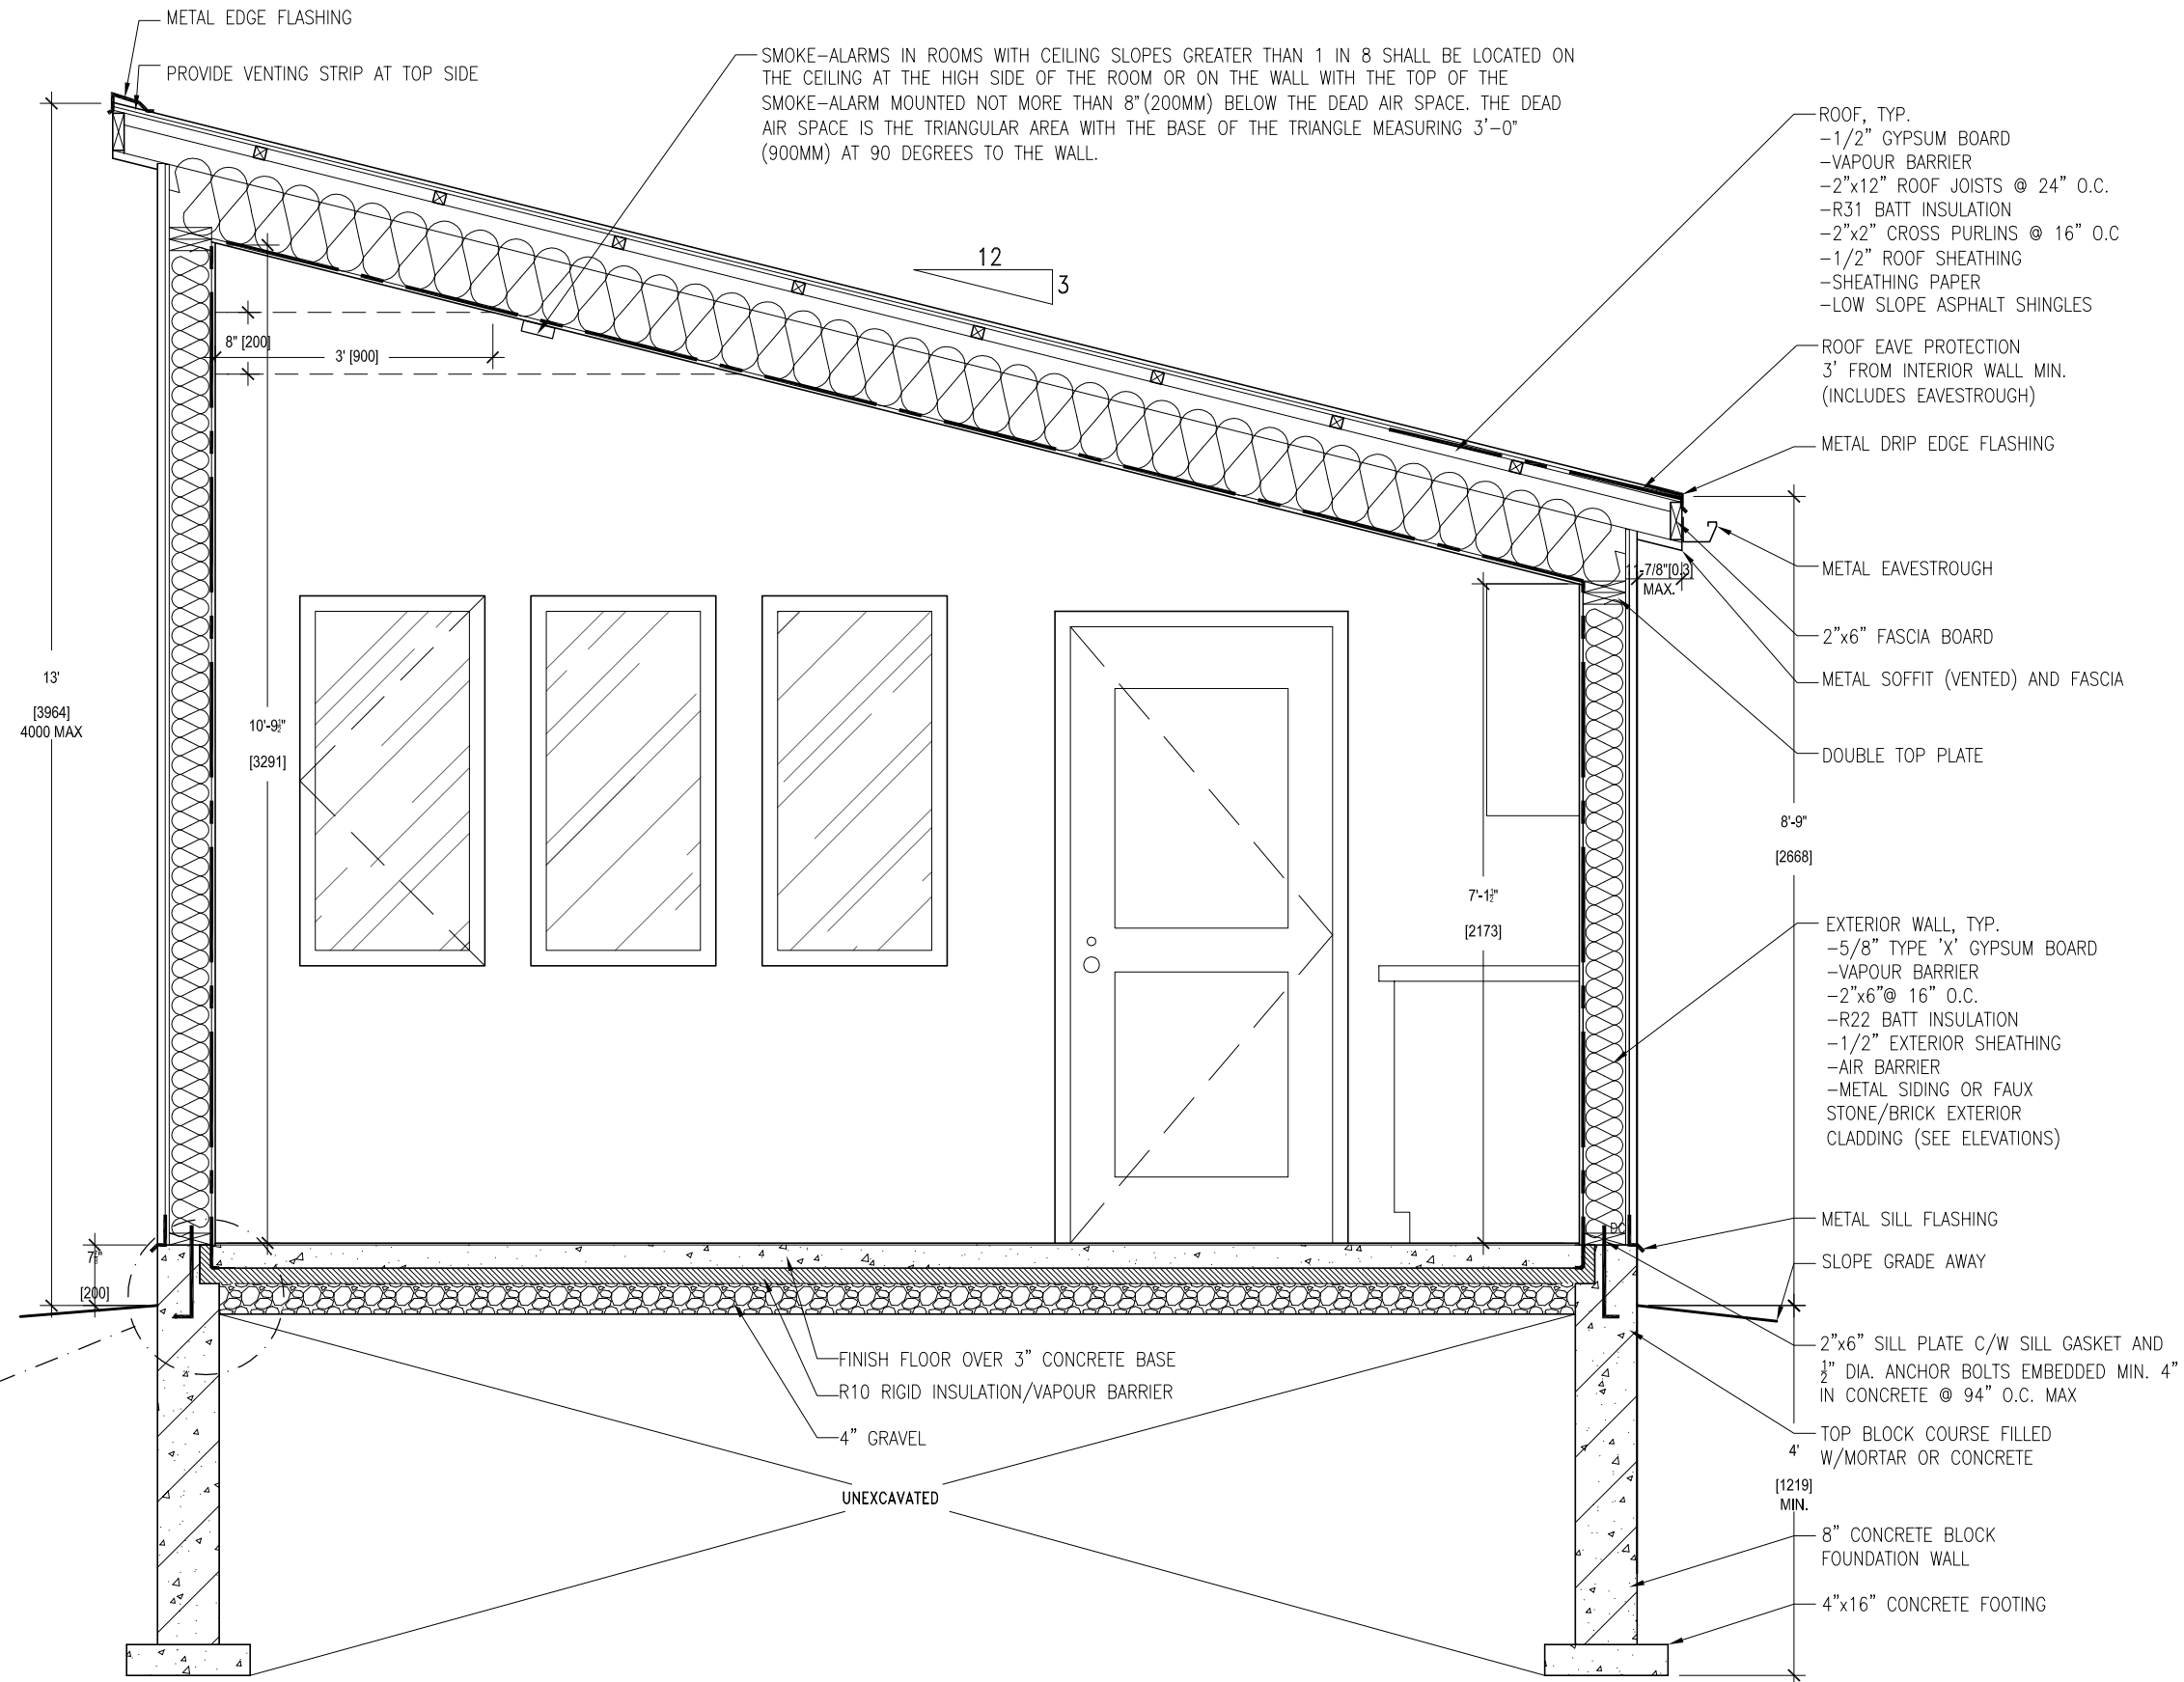

1	AS PER DIVISION COMMENTS	07/2025
NO.	REVISION	DATE
TITLE: STUDIO GARDEN SUITE PRE-APPROVED PLANS		
DATE:	MARCH 2025	DRAWING NO.:
SCALE:	1/2" = 1'-0"	A5




CITY OF TORONTO
TORONTO BUILDING DIVISION
DEVELOPMENT AND GROWTH
SERVICES
100 QUEEN ST W
TORONTO, ON, M5H 2N2

GSF-2 PACKAGE
GARDEN SUITE
FURNACE- FIRE
ALARM OPTION

FOR
REFERENCE
ONLY

BUILDING SECTION
(ROOF OPTION 2)

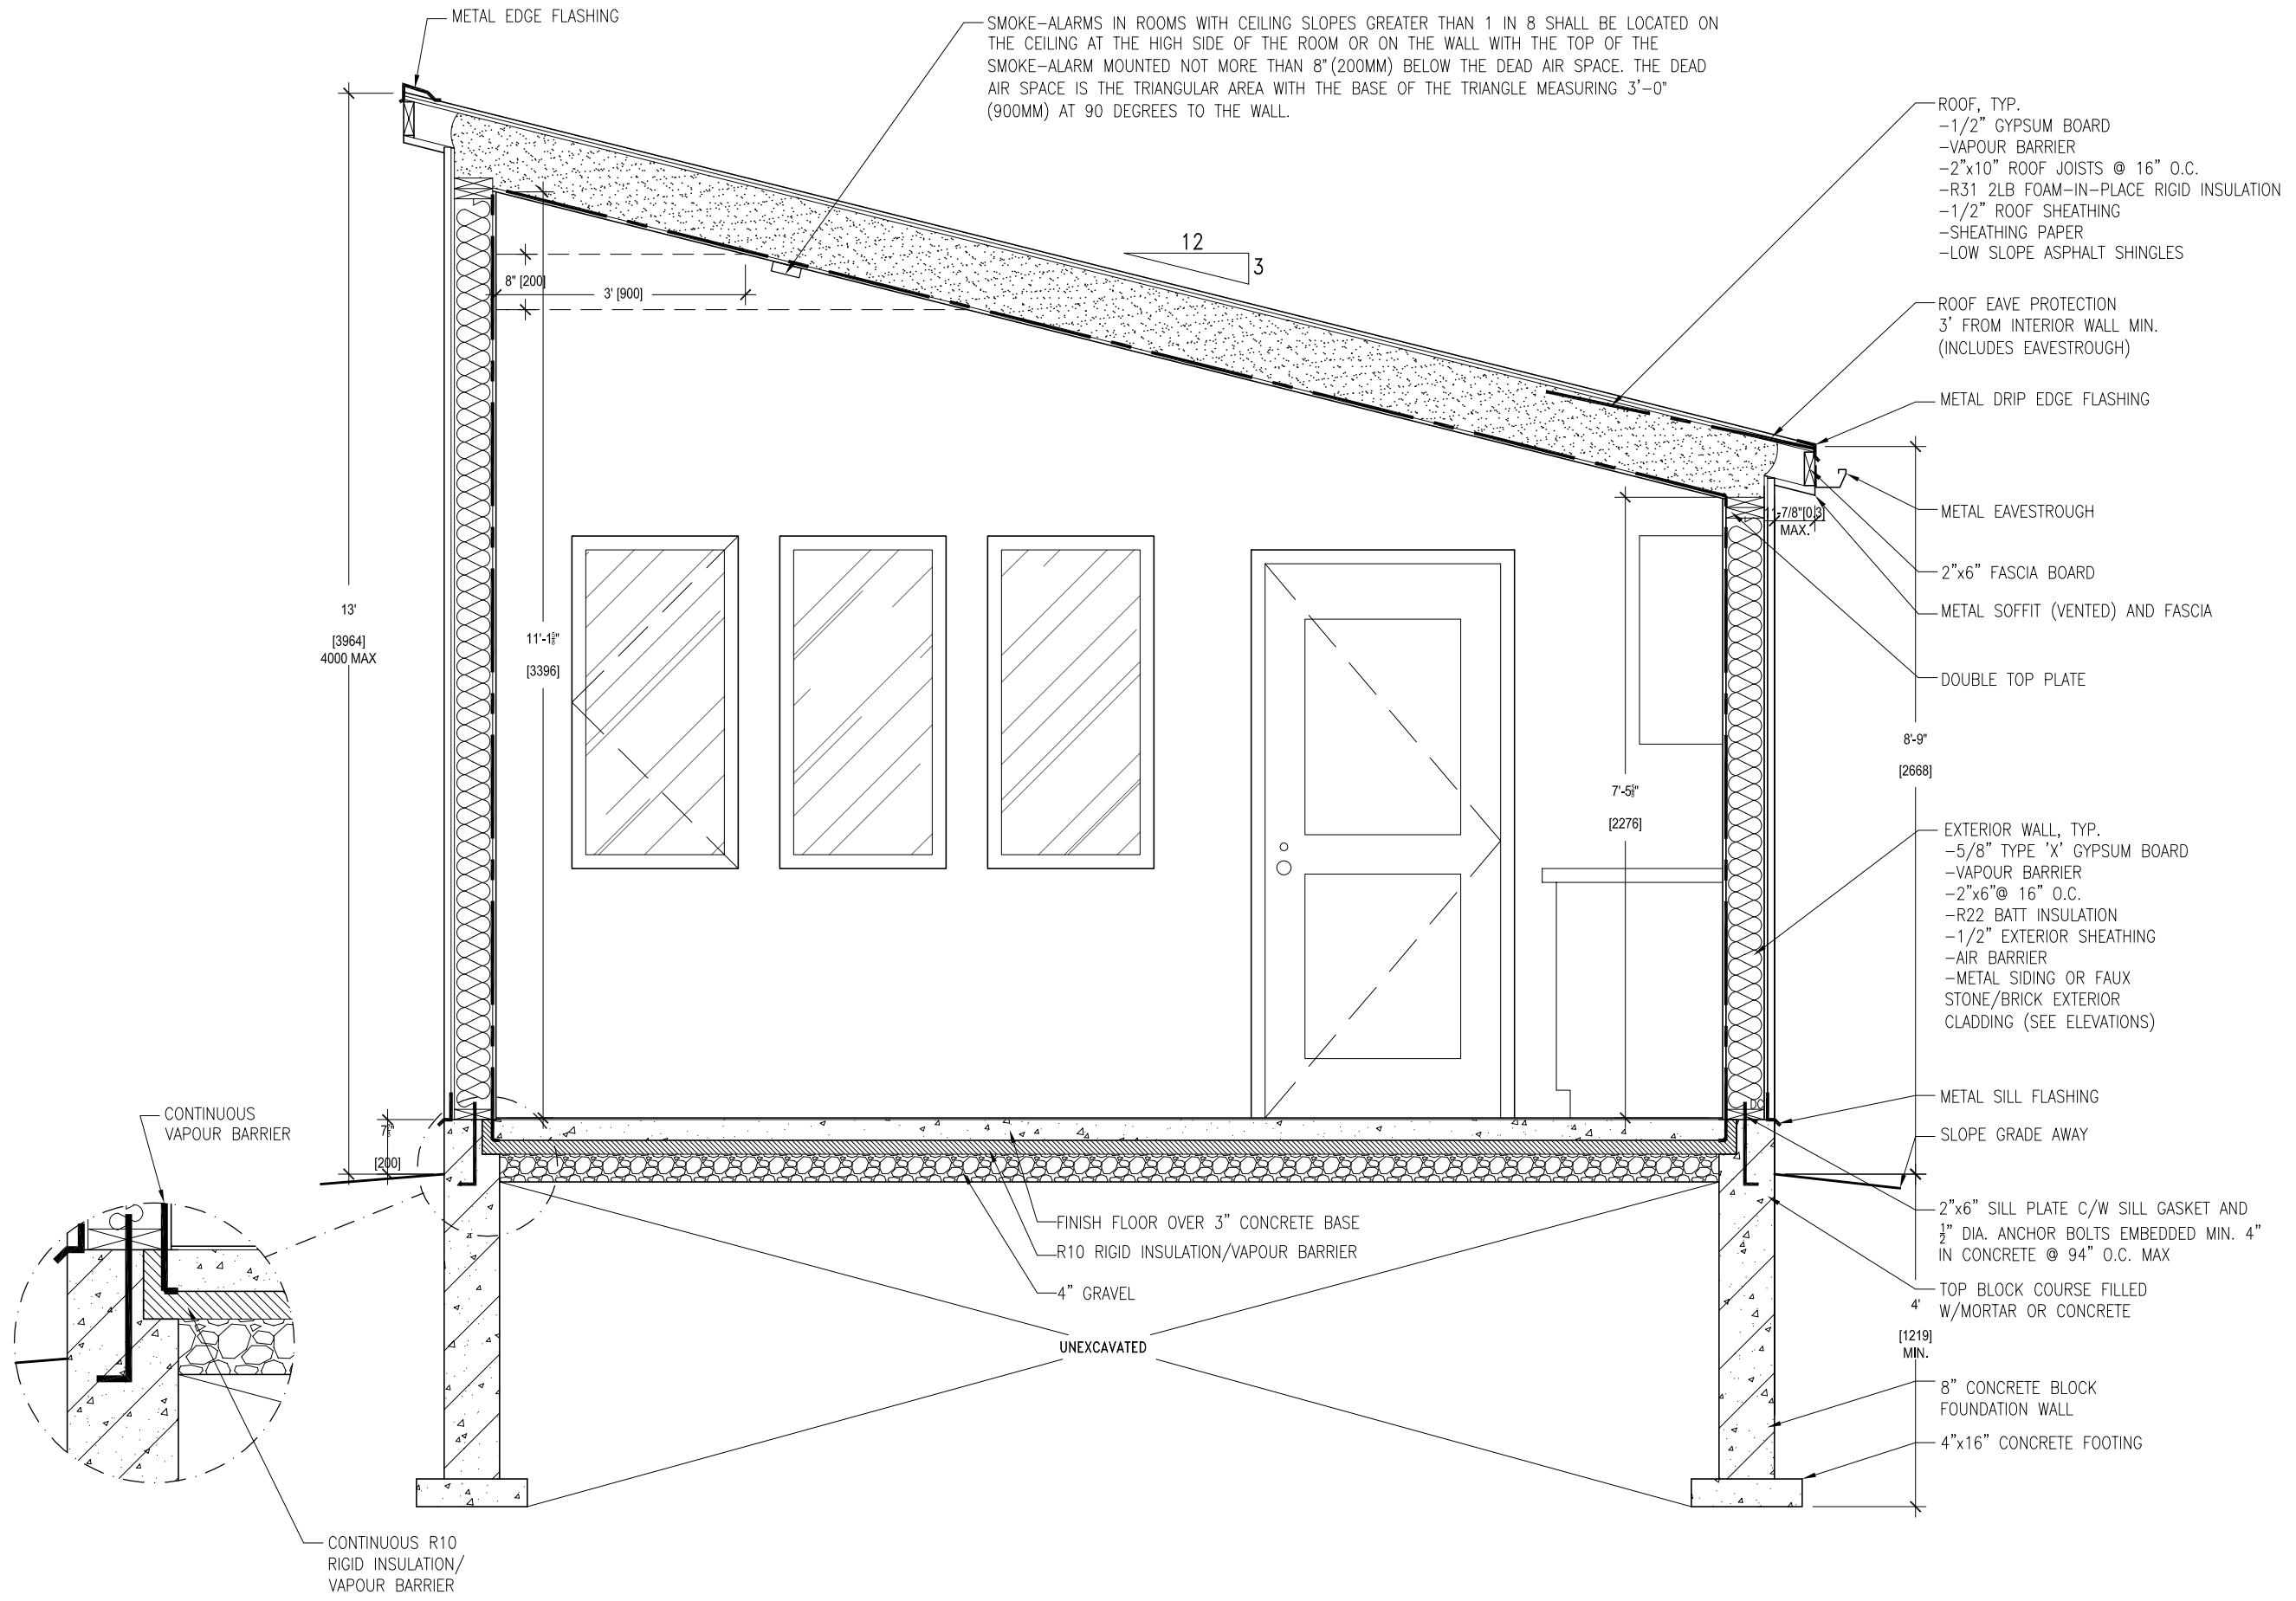

1	AS PER DIVISION COMMENTS	07/2025
NO.	REVISION	DATE
TITLE: STUDIO GARDEN SUITE PRE-APPROVED PLANS		
DATE:	MARCH 2025	DRAWING NO.:
SCALE:	1/2" = 1'-0"	A5-2

Toronto
CITY OF TORONTO
TORONTO BUILDING DIVISION
DEVELOPMENT AND GROWTH
SERVICES
100 QUEEN ST W
TORONTO, ON, M5H 2N2

EXCAVATIONS AND BACKFILL

- EXCAVATIONS SHALL PREVENT DAMAGE TO EXISTING STRUCTURES, ADJACENT PROPERTIES AND UTILITIES.
- EXCAVATIONS SHALL NOT IMPOSE INTO ANY ADJACENT PROPERTIES FOOTING'S ANGLE OF REPOSE UNLESS APPROVED AND MONITORED BY A PROFESSIONAL ENGINEER OF ONTARIO.
- EXCAVATION BASE SHALL BE FREE OF ANY ORGANIC MATERIALS.
- EXCAVATION BASE BEARING CAPACITY SHALL MEET THE ONTARIO BUILDING CODE MINIMUM UNLESS OTHERWISE STATED BY A PROFESSIONAL ENGINEER OF ONTARIO.

- ALL BACKFILL MATERIAL WITHIN 24" (600MM) OF THE FOUNDATION WALL SHALL BE FREE OF DELETERIOUS DEBRIS AND BOULDERS OVER 10" (250MM) DIAMETER.

FOOTINGS AND FOUNDATIONS

- FOOTINGS SHALL BE MINIMUM 20MPA POURED CONCRETE AND A MINIMUM OF 48" (1200MM) BELOW FINISHED GRADE.
- FOOTINGS SHALL BE FOUNDED ON NATURAL UNDISTURBED SOIL, ROCK OF COMPACTED GRANULAR FILL WITH A MINIMUM BEARING CAPACITY OF 11 PSI (75KPA).
- FOUNDATION WALLS SHALL EXTEND MINIMUM OF 7-7/8" (200MM) ABOVE FINISHED GRADE.
- MASONRY FOUNDATION WALLS SHALL BE PARGED WITH 1/4" (6MM) OF MORTAR COVED OVER THE FOOTING PRIOR TO DAMPPROOFING.

- FOUNDATION WALLS SHALL BE BRACED PRIOR TO BACKFILLING.
- THE EXTERIOR GRADING SHALL BE GRADED SO THAT THE SURFACE IS GRADING AWAY FROM THE BUILDING AND SHALL NOT ADVERSELY AFFECT ADJACENT PROPERTIES.

- WHERE A FOUNDATION BEARS ON GRAVEL, SAND OR SILT, AND THE WATER TABLE IS WITHIN A DISTANCE BELOW THE BEARING SURFACE EQUAL TO THE WIDTH OF THE FOUNDATION, THE ALLOWABLE BEARING PRESSURE SHALL BE 50% OF THAT DETERMINED IN ARTICLE 9.4.4.1. THE FOOTING WIDTH FOR WALLS AND FOOTING AREA FOR COLUMNS SHALL COMPLY WITH SENTENCE 9.15.3.6.(3).

CONCRETE FLOOR SLABS

- GARAGE, CARPORT AND EXTERIOR SLABS AND STEPS SHALL BE 32MPA CONCRETE WITH 5-8% AIR ENTRAINMENT.
- INTERIOR SLAB 25MPA CONCRETE, MINIMUM 3" (75MM) THICK OVER R10 RIGID INSULATION AND MINIMUM 4" (100MM) OF COARSE, CLEAN, GRANULAR MATERIAL.
- ATTACHED GARAGE CONCRETE SLABS SHALL BE SLOPED TO DRAIN TO THE EXTERIOR.

WOOD FRAME CONSTRUCTION

- ALL LUMBER SHALL BE SPRUCE-PINE-FIR NO. 1 & 2, CONTAIN A GRADE STAMP AND MAXIMUM MOISTURE CONTENT 19% AT TIME OF INSTALLATION.
- ALL FRAMING LUMBER WHICH ARE SUPPORTED ON CONCRETE IN DIRECT CONTACT WITH SOIL SHALL BE SEPARATED FROM THE CONCRETED WITH 0.05MM POLYETHYLENE OR TYPE 'S' ROLL ROOFING.
- ALL EXTERIOR FRAMING LUMBER SHALL BE PRESSURE TREATED LUMBER AND CUT ENDS ARE TO BE TREATED TO MAINTAIN TREATMENT.
- EXTERIOR WALLS AND INTERIOR LOAD BEARING WALLS TO CONTAIN SINGLE BOTTOM PLATE AND DOUBLE TOP PLATE.
- FLOOR JOIST TO HAVE MINIMUM 1-1/2" (38MM) OF END BEARING.
- FLOOR JOIST SHALL BEAR ON A SILL PLATE FIXED TO FOUNDATION WITH 1/2" (12.7MM) ANCHOR BOLTS SPACED 7'-10" (2400MM) MAX.
- HEADER JOIST BETWEEN 3'-11" (1200MM) AND 10'-6" (3200MM) IN LENGTH SHALL BE DOUBLED. HEADER JOIST EXCEEDING 10'-6" (3200MM) SHALL BE SIZED BY CALCULATIONS.
- TRIMMER JOIST SHALL BE DOUBLE WHEN SUPPORTED HEADER IS BETWEEN 2'-7" (800MM) AND 6'-8" (2000MM). TRIMMER JOISTS EXCEEDING 6'-6" (2000MM) SHALL BE SIZED BY CALCULATIONS.
- 2"x2" CROSS BRIDGING REQUIRED NOT MORE THAN 6'-10"

(2100MM) FROM EACH SUPPORTED AND OTHER CROSS BRIDGING.

- JOISTS SHALL BE SUPPORTED ON JOIST HANGERS AT ALL FLUSH BEAMS, TRIMMERS AND HEADERS.
- NON-LOADING WALLS SHALL BE SUPPORTED ON A DOUBLE JOIST OR ON WOOD BLOCKING SPACED 2'0" (600MM) O.C. BETWEEN JOISTS.
- HIP AND VALLEY RAFTER SHALL BE 2" (38MM) DEEPER THAN THE COMMON RAFTER.
- 2"x4" (38MM X89MM) COLLAR TIES WITH 1"x4" (19MM X 89MM) CONTINUOUS BRACE AT MID SPAN IF COLLAR TIE EXCEEDS 7'-10" (2400MM) IN LENGTH.

- HOLES IN FLOOR, ROOF AND CEILING MEMBERS TO BE NOT LARGER THAN 1/4 THE ACTUAL DEPTH OF MEMBER AND NOT LESS THAN 2" (50MM) FROM EDGES.

- HOLES IN FLOOR, ROOF AND CEILING MEMBERS TO BE LOCATED ON TOP OF THE MEMBER WITHIN 1/2 THE ACTUAL DEPTH FROM THE OF BEARING AND NOT GREATER THAN 1/3 THE JOIST DEPTH.
- WALL STUDS MAY BE NOTCHED OR DRILLED PROVIDED THAT NO LESS THAN 2/3 THE DEPTH OF THE STUD REMAINS, IF LOAD BEARING, AND 1-1/2" (40MM) IF NON-LOAD BEARING.
- ROOF TRUSSES MEMBERS SHALL NOT BE NOTCHED, DRILLED OR WEAKENED UNLESS ACCOMMODATED IN THE DESIGN.
- ENGINEERED LUMBER JOIST OR BEAMS CAN BE NOTCHED OR DRILLED AS PER MANUFACTURER'S SPECIFICATIONS AND RECOMMENDATIONS.

COLUMNS, BEAMS AND LINTELS

- STEEL BEAMS AND COLUMNS SHALL BE PRIMED.
- MINIMUM 3-1/2" (89MM) END BEARING FOR BEAMS WITH 7-1/2" SOLID MASONRY BENEATH THE BEAM.
- STEEL COLUMNS TO HAVE MINIMUM OUTSIDE DIAMETER OF 3" (73MM) AND 3/16" (5MM) MINIMUM THICKNESS.
- WOOD COLUMNS FOR CARPORTS AND GARAGES SHALL BE MINIMUM 3-1/2" X 3-1/2" (89MM X 89MM), IN ALL OTHER CASES EITHER 5-1/2" X 5-1/2" (140MM X 140MM) OR 7-1/2"(184MM) ROUND, UNLESS CALCULATIONS BASED ON ACTUAL LOADS SHOW LESSER SIZES ARE ADEQUATE. ALL COLUMNS SHALL BE NOT LESS THAN THE WIDTH OF THE SUPPORTED MEMBER.
- PROVIDE SOLID BLOCKING THE FULL WIDTH OF THE SUPPORTED MEMBER UNDER ALL CONCENTRATED LOADS.

- WHERE 38MM MEMBERS IN BUILT-UP WOOD BEAMS ARE NOT NAILED TOGETHER, THEY SHALL BE BOLTED W/ NOT LESS THAN 12.7MM DIAM BOLTS EQUIPPED WITH WASHERS SPACED NOT MORE THAN 1.2M O.C., END BOLTS LOCATED NOT MORE THAN 600MM FROM THE ENDS OF THE MEMBERS.

THERMAL INSULATION

- MINIMUM THERMAL PERFORMANCE REQUIREMENTS FOR SB12 PACKAGE A-1:

	ZONE 1
CEILING WITH ATTIC SPACE	R60
CEILING WITHOUT ATTIC SPACE	R31
EXPOSED FLOOR	R31
WALLS ABOVE GRADE	R22
BASEMENT WALLS	R20 C.I.
EDGE OF BELOW GRADE SLAB	R10
[≤ 1'-11" (600mm) BELOW GRADE]	
WINDOWS AND SLIDING GLASS DOORS	U 0.28 MAX.
SKYLIGHTS	U 0.50 MAX.
- INSULATION SHALL BE PROTECTED BY GYPSUM BOARD EXCEPT FOR UNFINISHED BASEMENTS WHERE 6ML POLY. IS SUFFICIENT FOR FIBERGLASS TYPE INSULATIONS.
- DUCTS THRU UNHEATED SPACE SHALL BE AIRTIGHT WITH TAPE OR SEALANT, DUCTS SHALL BE INSULATED WITH MINIMUM R12 (RSI 2.11).
- CAULKING SHALL BE APPLIED TO ALL EXTERIOR DOORS AND WINDOWS BETWEEN THE FRAME AND EXTERIOR CLADDING.
- WEATHERSTRIPPING SHALL BE PROVIDED ON ALL DOORS AND ACCESS HATCHES TO THE EXTERIOR, EXCEPT DOORS FROM A GARAGE TO THE EXTERIOR.
- EXTERIOR WALLS, CEILING AND FLOORS SHALL BE CONSTRUCTED SO AS TO PROVIDE A CONTINUOUS BARRIER TO THE PASSAGE OF WATER VAPOUR FROM.
- THE INTERIOR AND TO THE LEAKAGE OF AIR FROM THE EXTERIOR.

ROOFING

- FASTENERS FOR ROOFING SHALL BE CORROSION RESISTANT AND SHALL PENETRATE THROUGH OR AT LEAST 1/2" INTO ROOF SHEATHING.
- EVERY ASPHALT SHINGLE SHALL BE FASTENED WITH AT LEAST 4 NAILS FOR 3'-3" (1000MM) WIDE SHINGLE.
- EAVE PROTECTION SHALL EXTEND 3'-0" (900MM) UP THE ROOF SLOPE FROM THE EDGE, AND AT LEAST 1'-0" (300MM) FROM THE INSIDE FACE OF THE EXTERIOR WALL. EAVE PROTECTION IS NOT REQUIRED FOR UNHEATED BUILDINGS.
- OPEN VALLEYS SHALL BE FLASHED WITH 2 LAYERS OF ROLL ROOFING OR 1 LAYER OF METAL FLASHING.

- FLASHING SHALL BE PROVIDED AT SHINGLED ROOF AND EXTERIOR WALL OR CHIMNEY INTERSECTIONS.

- ACCESS TO ROOF ATTIC (>108 S.F. (10 S.M.)) TO BE MINIMUM 20" (500MM) X 28" (700MM) INSULATED AND WEATHERSTRIPPED.

- WHERE PANEL-TYPE ROOF SHEATHING REQUIRE EDGE SUPPORT, THE SUPPORT SHALL CONSIST OF METAL H CLIPS OR NOT LESS THAN (1-1/2 ") 38MM BY (1-1/2 ") 38MM BLOCKING SECURELY NAILED BETWEEN FRAMING MEMBERS. NOT REQUIRED WHEN TONGUED-AND-GROOVED EDGED PANEL-TYPE SHEATHING BOARD IS USED.

- EVERY ATTIC OR ROOF SPACE SHALL BE PROVIDED WITH AN ACCESS HATCH WHERE THE ATTIC OR ROOF SPACE MEASURES NOT LESS THAN 10M2 IN AREA, 1000MM IN LENGTH OR WIDTH, AND 600MM IN HEIGHT. THE HATCH SHALL BE NOT LESS THAN 22"x36" (550MM BY 900MM) EXCEPT THAT, WHERE THE HATCH SERVES NOT MORE THAN ONE DWELLING UNIT, THE MATCH MAY BE REDUCED TO 0.32M2 IN AREA WITH NO DIMENSION LESS THAN 20" (500MM).

NATURAL VENTILATION

- EVERY ROOF SPACE ABOVE AN INSULATED CEILING SHALL BE VENTILATED WITH OBSTRUCTED OPENINGS EQUAL TO NOT LESS THAN 1/300 OF THE INSULATED CEILING AREA.
- EVERY ROOF SPACE WITHOUT ATTIC SPACE SHALL BE VENTILATED WITH OBSTRUCTED OPENINGS EQUAL TO NOT LESS THAN 1/150 OF THE INSULATED CEILING AREA.
- ROOF VENTS SHALL BE UNIFORMLY DISTRIBUTED AND DESIGNED TO PREVENT THE ENTRY OF RAIN, SNOW OR INSECTS.

- UNHEATED CRAWL SPACE SHALL BE VENTED TO A MINIMUM 1 S.F. (0.1 S.M.) FOR EVERY 538 S.F. (500 S.M.).

- PROVIDE 4" (100MM) Ø VENT OPENING FOR COLD CELLAR WITHOUT WINDOWS AND DESIGNED TO PREVENT THE ENTRY OF OF RAIN, SNOW OR INSECTS.

DOOR AND WINDOWS

- EXTERIOR DWELLING DOORS AND WINDOWS WITHIN 6'-6" (2000MM) FROM GRADE SHALL BE CONSTRUCTED TO RESIST FORCED ENTRY. DOORS SHALL HAVE A DEADLOCK BOLT.
- 10% FLOOR AREA OF HABITABLE ROOMS TO EQUAL TRANSPARENT OPENINGS IN WINDOW, NATURAL VENTILATION 3 S.F. (0.279 S.M.) MINIMUM.
- 5% FLOOR AREA OF BEDROOMS TO EQUAL TRANSPARENT OPENINGS IN WINDOW OF 6 S.F. (0.557 S.M.) MINIMUM.

- PROVIDE STORM WINDOWS AND DOORS TO ALL EXTERIOR OPENINGS.

EXTERIOR WALLS

- NO WINDOWS OR OTHER UNPROTECTED OPENINGS ARE PERMITTED IN EXTERIOR WALLS LESS THAN 3'-11" (1200MM) FROM PROPERTY LINES.
- 5/8" (15.9MM) TYPE 'X' FIRE RATED GYPSUM BOARD SHALL BE INSTALLED ON THE INSIDE FACE EXTERIOR WALLS AND GABLE ENDS OF ROOFS WHICH ARE LESS THAN 3'-11"(1200MM) AND NOT LESS THAN 2' (600MM) FROM PROPERTY LINES.
- NON-COMBUSTIBLE CLADDING SHALL BE INSTALLED ON ALL EXTERIOR WALLS LESS THAN 2' (600MM) FROM PROPERTY LINES.

GARAGE GASPROOFING

- WALLS AND CEILING OF AN ATTACHED GARAGE SHALL BE CONSTRUCTED AND SEALED SO AS TO PROVIDE AN EFFECTIVE BARRIER TO EXHAUST FUMES.

- ALL PENETRATIONS THROUGH THE WALLS AND CEILING SHALL BE CAULKED.
- DOORS BETWEEN THE DWELLING AND ATTACHED GARAGE MAY NOT OPEN INTO A BEDROOM AND SHALL BE WEATHERSTRIPPED AND HAVE A SELF-CLOSER.

STAIRS

- STAIRS TO MEET OBC REQUIREMENTS:

MINIMUM RISE	4½" (125mm)
MAXIMUM RISE	7½" (200mm)
MINIMUM RUN	10" (255mm)
MAXIMUM RUN	13½" (355mm)
MINIMUM HEAD ROOM	6'-6½" (1950mm)
MINIMUM WIDTH	33½" (860mm)

- TAPERED TREADS SHALL HAVE A MINIMUM RUN OF 6" (150MM) AT THE NARROW END AND MINIMUM RUN FROM 12" (300MM) FROM THE NARROW END HANDRAIL CENTERLINE.

- WINDERS WHICH CONVERGE TO A POINT IN STAIRS MUST TURN THROUGH AN ANGLE OF NO MORE THAN 90° WITH NO LESS THAN 30° OR MORE THAN 45° PER TREAD. SETS OF WINDERS MUST BE SEPARATED IN PLANE BY AT LEAST 4'-0" (1200MM).

- A LANDING IS REQUIRED AT THE TOP OF ANY STAIR LEADING TO THE PRINCIPAL ENTRANCE TO A DWELLING AND OTHER EXTERIOR ENTRANCES WITH MORE THAN THREE RISERS.

- EXTERIOR CONCRETE STAIRS WITH MORE THAN TWO RISERS REQUIRE FOUNDATION.

HANDRAILS AND GUARDS

- A HANDRAIL IS REQUIRED FOR INTERIOR STAIRS CONTAINING MORE THAN TWO RISERS AND EXTERIOR STAIRS CONTAINING MORE THAN THREE RISERS.

- GUARDS ARE REQUIRED ROUND EVERY ACCESSIBLE SURFACE WHICH IS MORE THAN 2'-0" (600MM) ABOVE THE ADJACENT LEVEL AND WHERE THE ADJACENT SURFACE WITHIN 1.2 M.

- INTERIOR AND EXTERIOR GUARDS MINIMUM 3'-0" (900MM) HIGH. EXTERIOR GUARDS MINIMUM 3'-6" (1070MM) HIGH WHERE HEIGHT ABOVE ADJACENT SURFACE EXCEEDS 5'-10" (1800MM).

- GUARDS SHALL HAVE OPENINGS SMALLER THAN 4" (100MM) AND NO MEMBER BETWEEN 5'-1/2" (140MM) AND 3'-0" (900MM) THAT WILL FACILITATE CLIMBING.

ALARMS AND DETECTORS

- AT LEAST ONE SMOKE ALARM SHALL BE INSTALLED ON OR NEAR THE CEILING IN EACH FLOOR AND BASEMENT LEVEL 3'-0" (900MM) OR MORE ABOVE AN ADJACENT LEVEL.
- SMOKE ALARMS SHALL BE INTERCONNECTED AND LOCATED IN EVERY BEDROOM C/W VISUAL COMPONENT.
- A CARBON MONOXIDE ALARM SHALL BE INSTALLED ADJACENT TO EVERY SLEEPING AREA FOR DWELLINGS WITH FUEL BURNING FIREPLACE OR STOVE, OR ATTACHED GARAGE.
- SMOKE-ALARMS SHALL BE LOCATED ON THE CEILING AT LEAST 4" (100MM) FROM ANY WALL MEASURED TO THE NEAREST EDGE OF THE UNIT OR ON A WALL WITH THE TOP EDGE 4" TO 12" (100 TO 300MM) FROM THE CEILING.

- SMOKE-ALARMS IN ROOMS WITH CEILING SLOPES GREATER THAN 1 IN 8 SHALL BE LOCATED ON THE CEILING AT THE HIGH SIDE OF THE ROOM OR ON THE WALL WITH THE TOP OF THE SMOKE-ALARM MOUNTED NOT MORE THAN 8" (200MM) BELOW THE DEAD AIR SPACE. THE DEAD AIR SPACE IS THE TRIANGULAR AREA WITH THE BASE OF THE TRIANGLE MEASURING 3'-0" (900MM) AT 90 DEGREES TO THE WALL.

- SMOKE-ALARMS SHALL BE LOCATED WHERE THEY WILL BE EXPOSED TO AIR FLOW DURING A FIRE CONDITION, AND SHALL NOT BE LOCATED IN THE VICINITY OF "DEAD" AIR SPACES.

- ON CEILINGS WITH EXPOSED JOISTS OR BEAMS, SMOKE-ALARMS SHALL BE MOUNTED ON THE BOTTOM OF JOISTS OR BEAMS. (REFER TO FIGURE 3 AND APPENDIX A.)

ROOF DRAINAGE

- ROOF WATER FROM UPPER ROOF LEVEL SHALL BE PIPED DIRECTLY TO GRADE AWAY FROM THE BUILDING.
- NO ROOF WATER TO DRAIN TO ADJACENT PROPERTIES.

PLUMBING

- EVERY DWELLING REQUIRES A KITCHEN SINK, LAVATORY, TOILET, BATHTUB OR SHOWER STALL AND THE INSTALLATION OR AVAILABILITY OF LAUNDRY FACILITIES.
- WHERE PIPING MAY BE EXPOSED TO FREEZING CONDITIONS, IT SHALL BE PROTECTED FROM THE EFFECTS OF FREEZING [REFER TO 7.3.5.4.]

ELECTRICAL

- AN EXTERIOR LIGHT CONTROLLED BY AN INTERIOR SWITCH IS REQUIRED AT EVERY ENTRANCE.
- A LIGHT CONTROLLED BY A SWITCH IS REQUIRED IN EVERY KITCHEN, BEDROOM, LIVING ROOM, UTILITY ROOM, LAUNDRY ROOM, DINING ROOM, BATHROOM, VESTIBULE, HALLWAY, GARAGE AND CARPORT. A SWITCH RECEPTACLE MAY BE PROVIDED INSTEAD OF A LIGHT IN BEDROOMS AND LIVING ROOMS.
- STAIRS SHALL BE LIGHTED AND EXCEPT WHERE SERVING AN UNFINISHED BASEMENT SHALL BE CONTROLLED BY A THREE WAY SWITCH AT THE TOP AND BASE OF THE STAIRS.
- BASEMENTS REQUIRE A LIGHT FOR EACH 323 S.F 30 S.M.) CONTROLLED BY A SWITCH AT THE TOP OF THE STAIRS.

MECHANICAL VENTILATION

- A MECHANICAL VENTILATION SYSTEM IS REQUIRED WITH A TOTAL CAPACITY AT LEAST EQUAL TO THE SUM OF:
 - 10.0 L/S EACH FOR BASEMENT AND MASTER BEDROOM
 - 5.0 L/S FOR EACH OTHER ROOM
- A PRINCIPAL DWELLING EXHAUST SHALL BE INSTALLED AND CONTROLLED BY A CENTRALLY LOCATED SWITCH IDENTIFIED AS SUCH.
- SUPPLEMENTAL EXHAUST SHALL BE INSTALLED SO THAT THE TOTAL CAPACITY OF ALL KITCHEN, BATHROOMS AND OTHER EXHAUSTS, LESS THE PRINCIPAL EXHAUST, IS NOT LESS THAN THE TOTAL REQUIRED CAPACITY.

- A HEAT RECOVERY VENTILATOR MAY BE EMPLOYED IN LIEU OF EXHAUST TO PROVIDE VENTILATION. AN HRV IS REQUIRED IF ANY SOLID FUEL BURNING APPLIANCES ARE INSTALLED.

- SUPPLY AIR INTAKES SHALL BE LOCATED SO AS TO AVOID CONTAMINATION FROM EXHAUST OUTLETS.

FIRE FIGHTER ACCESS ROUTE

- ACCESS PATHS FROM THE STREET TO THE FRONT DOOR OF THE GARDEN SUITE SHALL BE CONSTRUCTED OF CONCRETE, ASPHALT, BRICK, OR ALTERNATE HARD SURFACE.
- GRADIENT CHANGES, INCLUDING STAIRS, ARE BUILDING CODE COMPLIANT.
- NO LOCKED GATES ALONG PATH OF TRAVEL.
- THE HORIZONTAL PATH OF TRAVEL PERMITS THE TRANSPORT OF A 24-FOOT EXTENSION LADDER (COLLAPSED LENGTH - 12 FEET FOR A SMOOTH PATH OF TRAVEL TO NAVIGATE AND AVOID ANY SHARP TURNING RADIUS).

- ACCESS PATHS MUST REMAIN UNOBSTRUCTED AND CLEAR OF SNOW AND ICE.

GENERAL NOTES

- ALL DRAWINGS AND SPECIFICATIONS ARE THE PROPERTY OF THE CITY OF TORONTO AND ARE TO BE USED FOR BUILDING PERMITS WITHIN THE CITY OF TORONTO.
- THE CONTRACTOR SHALL CHECK AND VERIFY ALL DIMENSION AND EXISTING CONDITIONS.
- INSTALL EXTERIOR CLADDING AS PER MANUFACTURER'S SPECIFICATIONS AND DETAILS.
- INSTALL FLASHING, TRIM AND CAULKING TO EXTERIOR CLADDING TO PREVENT WATER PENETRATIONS.
- INSTALL ROOF SKYLIGHT AS PER MANUFACTURER'S SPECIFICATIONS AND DETAILS.
- INSTALL KITCHEN AND WASHROOM CABINETS AS PER MANUFACTURER'S SPECIFICATIONS AND DETAILS.
- INSTALL INTERIOR TRIM, FLOORING AND DOORS AS PER MANUFACTURER'S SPECIFICATIONS AND DETAILS.
- DESIGN LOADS:
 - UNIFORMLY DISTRIBUTED LIVE LOAD 1.9 KPA AND SNOW LOAD 1.2 KPA.

GSF-2 PACKAGE
GARDEN SUITE
FURNACE- FIRE
ALARM OPTION

FOR
REFERENCE
ONLY

SPECIFICATIONS

1	AS PER DIVISION COMMENTS	07/2025
NO.	REVISION	DATE

TITLE:
STUDIO GARDEN SUITE
PRE-APPROVED PLANS



DATE:	MARCH 2025	DRAWING NO.:	A6
SCALE:	NTS		



CITY OF TORONTO
TORONTO BUILDING DIVISION
DEVELOPMENT AND GROWTH
SERVICES
100 QUEEN ST W
TORONTO, ON, M5H 2N2

INSULATE ALL DUCTS EXPOSED TO UNCONDITION SPACE. PROVIDE R12, DENSITY REINFORCED, FOIL FACED FLEXIBLE DUCT INSULATION WITH VAPOR SEAL AND GASPROOFING

-ALL MATERIAL AND EQUIPMENT TO BE INSTALLED AS PER MANUFACTURER SPECIFICATIONS.
 -SEAL DUCT JOINTS IN CONDITIONED SPACES WITH CLASS C SEAL.
 -PROVIDE DOOR UNDERCUT FOR RETURN AIR.
 -ALL DUCT SHALL BE OF GALVANIZED STEEL.
 -ALL BRANCH SUPPLY DUCTS TO BE EQUIPPED WITH VOLUME CONTROL DAMPERS.

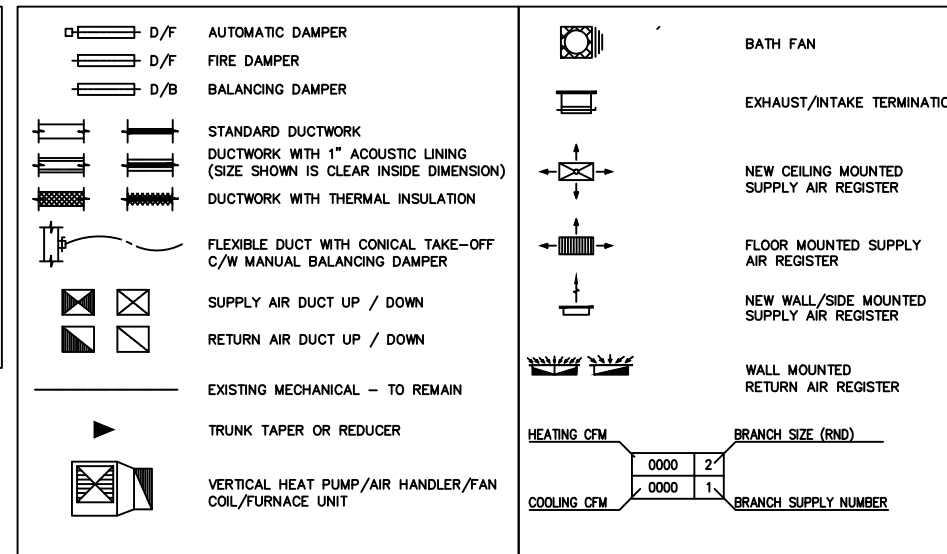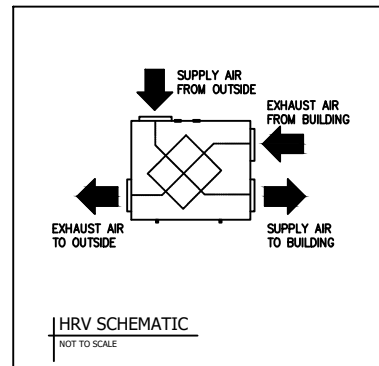

GSF-2 PACKAGE
GARDEN SUITE
FURNACE- FIRE
ALARM OPTION


FOR
REFERENCE
ONLY

OBC 9.32.3.4.(5) AN OUTDOOR AIR SUPPLY SHALL BE INSTALLED BETWEEN THE OUTDOORS AND THE FURNACE RETURN AIR PLENUM AND SHALL BE CONNECTED
 (A) NOT LESS THAN 3 M UPSTREAM OF THE PLENUM CONNECTION TO THE FURNACE, AS MEASURED ALONG THE LENGTH OF THE DUCT, OR
 (B) THROUGH AN ACCEPTABLE MIXING DEVICE INSTALLED IN THE RETURN AIR PLENUM.

OBC 6.3.2.10.(7) EXHAUST DUCTS CONNECTED TO LAUNDRY DRYING EQUIPMENT SHALL BE,
 (A) INDEPENDENT OF OTHER EXHAUST DUCTS,
 (B) DESIGNED AND INSTALLED THAT THE ENTIRE DUCT CAN BE CLEANED, AND
 (C) CONSTRUCTED OF SMOOTH CORROSION-RESISTANT MATERIAL.

OBC 9.32.3.13.(3) THE DISTANCE SEPARATING AIR INTAKES FOR MECHANICAL VENTILATION FROM EXHAUST OUTLETS THAT ARE POTENTIAL SOURCES OF CONTAMINANTS, SUCH AS GAS VENTS OR OIL FILL PIPES, SHALL BE NOT LESS THAN 1800 mm. (REFER TO KITCHEN EXHAUST AND ERV/HRV INTAKE LOCATIONS).

HRV TO BE INSTALLED AS PER MANUFACTURER SPECIFICATION.

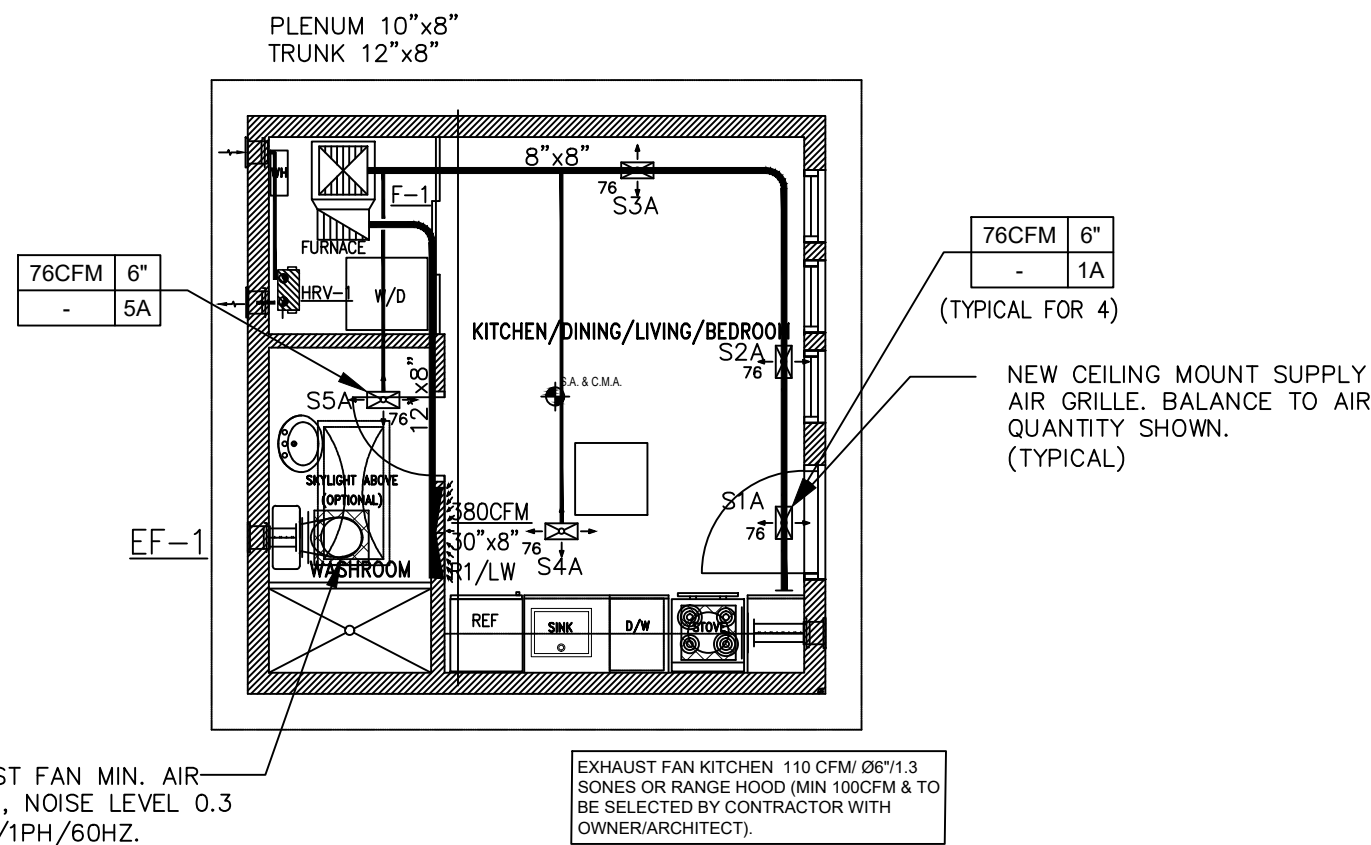

STUDIO GARDEN SUITE

SB-12 Table 3.1.1.2.A (IP), ZONE 1 - COMPLIANCE PACKAGE A1
 TOTAL HEAT LOSS-10626 BTU/H.
 HIGH EFFICIENCY GAS FURNACE: FURNACE HEATING INPUT - 28000 BTU/H, FURNACE HEATING OUTPUT - 26880 BTU/H, MIN 96% AFUE, SYSTEM AIR FLOW 380 CFM.
 HRV- 90 CFM @ 0.3" ESP, MIN. 75% SENSIBLE EFF. @ 0°C, COUPLED TO FORCED AIR HEATING SYSTEM.

1	AS PER DIVISION COMMENTS	07/2025
NO.	REVISION	DATE
TITLE: STUDIO GARDEN SUITE PRE-APPROVED PLANS		
DATE:	MARCH 2025	DRAWING NO.:
SCALE:	3/16"=1'	M1

CITY OF TORONTO
 TORONTO BUILDING DIVISION
 DEVELOPMENT AND GROWTH
 SERVICES
 100 QUEENS ST W
 TORONTO, ON, M5H 2N2

**FOR
REFERENCE
ONLY**

PLUMBING AND DRAINAGE NOTES

- ALL DRAINAGE PIPING 3" OR LESS SHALL BE SLOPPED IN THE DIRECTION OF FLOW.
- ALL DRAINAGE PIPING 4" OR LARGER SHALL BE SLOPPED IN THE DIRECTION OF THE FLOW.
- SANITARY DRAIN AND VENT PIPING ABOVE GRADE SHALL BE TYPE:
DMW HRD COPPER FITTINGS TO ASTM B306. WITH CAST BRASS OR WROUGHT COPPER CERTIFIED TO CAN/CSA B125, OR ABS SCHEDULE 40 PLASTIC PIPE CERTIFIED TO CAN/CSA-B181.1,
PVC SCHEDULE 40 PLASTIC PIPE CERTIFIED TO CAN/CSA-B181.12.,
XFR-PVC SCHEDULE 40 CERTIFIED TO CAN/CSA B181.2, "PVC DRAIN, WASTE AND VENT PIPE FITTINGS".
IPEX-SYSTEM 15 (DWV) SCHEDULE 40 CERTIFIED TO CAN/CSA-B181.2, "PVC DRAIN, WASTE AND VENT PIPE AND FITTINGS", OR CAST IRON PIPE CERTIFIED TO ASTM A888, PLAIN ENDS, ALL COUPLINGS SHALL BE HUBLESS JOINTS COUPLINGS WITH NEOPRENE GASKETS AND STAINLESS STEEL SHIELD AND CLAMPS.
- SANITARY DRAIN PIPING BELOW GRADE SHALL BE HUBLESS CAST IRON PIPE CERTIFIED TO ASTM A888, PLAIN ENDS, ALL COUPLINGS SHALL BE HUBLESS JOINT COUPLINGS WITH NEOPRENE GASKETS AND STAINLESS STEEL SHIELD AND CLAMPS.
DRAIN BELOW GRADE SHALL BE ABS SDR. USED UNDERGROUND OUTSIDE OF BUILDING OR UNDER A BUILDING. SANITARY DRAINAGE SYSTEM SHALL BE CERTIFIED TO CAN/CSA-B182.2, CAN/CSA-B181.1, OR
DRAIN BELOW GRADE SHALL BE PLASTIC PIPE, USED UNDERGROUND OUTSIDE OF BUILDING OR UNDER THE BUILDING. A SANITARY DRAINAGE SYSTEM OR VENTING SYSTEM SHALL BE CERTIFIED TO (C) CAN/CSA-B181.2, "PVC DRAIN, WASTE AND VENT PIPE AND PIPE FITTINGS. IPEX-SYSTEM 15 (DWV) SCHEDULE 40 CERTIFIED TO CAN/CSA-B181.2., IPEX BDS (BUILDIND DRAIN, SEWER AND STORM) CERTIFIED TO CAN/CSA.

- PUMPED DRAIN PIPING BELOW GRADE SHALL BE TYPE K SOFT COPPER, ASTM B88 SEAMLESS PLAIN ENDS.
- PROVIDE TRAP SEAL PRIMING TO ALL FLOOR DRAINS AS INDICATED WITH P-TRAPS IN ACCORDANCE WITH ONTARIO BUILDING CODE, PART 7 AND THE REQUIREMENTS OF ALL LOCAL AUTHORITIES HAVING JURISDICTION.
- LOCATE AND CONFIRM ELEVATIONS OF ALL SANITARY DRAINAGE TIE-IN POINTS.
- INSTALL AND TEST ALL PLUMBING AND DRAINAGE SYSTEMS IN ACCORDANCE WITH ONTARIO BUILDING CODE AND THE REQUIREMENTS OF ALL LOCAL AUTHORITIES HAVING JURISDICTION.
- FINAL LOCATIONS OF ALL FLOOR DRAINS TO BE CONFIRMED IN THE FIELD TO SUIT PROCESS EQUIPMENT LAYOUT AND INTERIOR WALLS.

ALL SANITARY VENT TERMINALS THAT PASSES THROUGH EXTERIOR WALLS SHALL BE VERTICAL, MINIMAL SIZE OF 3" AND TERMINATE A MINIMAL DISTANCE OF 1 METER ABOVE FROM ANY OPENABLE WINDOW, DOOR AND AIR INLET OR CONNECT DIRECTLY TO A BRANCH VENT OR VENT STACK WITHIN THE BUILDING.

PROVIDE SHUT OFF VALVES FOR A HOT AND COLD WATER SUPPLY LINES FOR EVERY INDIVIDUAL RESIDENTIAL SUITE IN ORDER TO INSULATE INDIVIDUAL SUITE WITHOUT AFFECTING THE WATER SUPPLY TO ANY OTHER AREA WITHIN THE BUILDING.

REMOVE CAPS FROM TEMPERATURE AND PRESSURE SAFETY RELIEF VALVE PARTS ON HOT WATER TANKS AND INSTALL TEMPERATURE AND PRESSURE SAFETY RELIEF VALVES.

PROVIDE A MIXING VALVE OR OTHER MEANS TO MAINTAIN A MAXIMUM HOT WATER TEMPERATURE OF 49°C TO ALL RESIDENTIAL SUITE.


PROVIDE A TRAP SEAL PRIMER OR AN EQUALLY EFFECTIVE WAY TO PROVIDE A TRAP SEAL FOR ALL FLOOR DRAINS AND TUB DOORS.

FIRE RATED PVC (XFR) PIPES SHALL BE USED FOR EACH PIPE PENETRATES THRU FIRE RATED ASSEMBLY.
ABS PIPES CAN BE USED WITHIN THE UNITS. PROVIDE FIRE STOP DONUTS AT EACH PIPE PENETRATION THRU FIRE RATED ASSEMBLY.

PROVIDE VALVE 1/2" COLD/ HOT WATER PIPING CONNECTIONS TO ALL PLG FIXTURES.

ALL SANITARY PIPES UNDER RAISED FLOOR OR SLAB, AND C/W AND H/W PIPE IN CEILING.

CONTRACTOR TO LOCATE ON SITE CONNECTION MAIN COLD WATER LINE, HOT WATER TANK AND DRAIN LINES IN MAIN BUILDING.

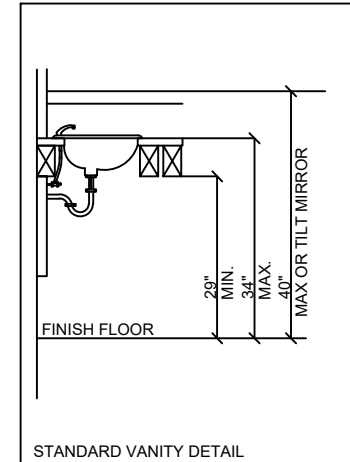

PLUMBING LEGEND

—	SANITARY DRAINAGE
---	DOMESTIC COLD WATER
-.-.-	DOMESTIC HOT WATER
CO	CEANOUT
FDO	FLOOR DRAIN

PLUMBING FIXTURE CONNECTION

TAG	DESCRIPTION	WATER		DRAIN	
		H.W.	H.W.	WASTE	VENT
WC	WATER CLOSET	-	1/2"	3"	1 1/2"
L	LAVATORY	1/2"	1/2"	1 1/2"	1 1/4"
KS	KITCHEN SINK	1/2"	1/2"	2"	1 1/2"
FD	FLOOR DRAIN	-	-	3"	1 1/2"
SH	SHOWER	1/2"	1/2"	1 1/2"	1 1/4"
TUB	BATH TUB	1/2"	1/2"	2"	1 1/2"
DW	DISHWASHER	1/2"	-	2"	1 1/2"

1	AS PER DIVISION COMMENTS	07/2025
NO.	REVISION	DATE
TITLE: PLUMBING NOTES PRE-APPROVED PLANS		
DATE:	MARCH 2025	DRAWING NO.:
SCALE:	3/16"=1'	P2

GSF-2 PACKAGE
GARDEN SUITE
FURNACE- FIRE
ALARM OPTION

FOR
REFERENCE
ONLY

FIRE ALARM LEGEND	
	RESIDENTIAL FIRE WARNING CONTROL UNIT
	SMOKE ALARM WITH VISUAL SIGNALING COMPONENTS
	FIRE ALARM SMOKE DETECTOR
	FIRE ALARM HEAT DETECTOR
	FIRE ALARM PULL STATION
	FIRE ALARM SIGNALING DEVICE
	SELF-CONTAINED 120V CARBON MONOXIDE AND SMOKE DETECTOR
	CARBON MONOXIDE DETECTOR
	HORN STROBE
	FIRE ALARM MINI HORN C/W RESET BUTTON
	CEILING SPEAKER
	STROBE
N	NEW
R	RELOCATED OR REMOVED
EX	EXISTING

OPTION 2: INCREASED FIRE PROTECTION MATERIALS AND BUILDING METHODS; EXTERIOR STROBE LIGHT; AND SMOKE ALARMS/WARNING SYSTEM

- THE STROBE LIGHT IS REQUIRED TO FACE THE LANEWAY SUITE.
- STROBE LIGHT TO BE RATED FOR THE OUDOOR USE AND ACTIVATED BY THE INTERCONNECTED SMOKE ALARMS OR HEAT DETECTORS WITHIN THE SUITE.
- THE FINAL STROBE DESIGN AND LOCATION WILL BE REQUIRED TO BE INSPECTED, TESTED AND MAINTAINED IN ACCORDANCE WITH SECTION 6.5 OF THE OFC.

- SEQUENCE OF OPERATIONS:
1. UPON DETECTION OF SMOKE BY ANY OF THE SMOKE ALARMS, THAT PARTICULAR SMOKE ALARM SOUND SHALL BECOME AUDIBLE AND STROBE LIGHT SHALL ILLUMINATE ON/OFF IN A STROBE LIKE MANNER.
 2. FURTHER TO POINT 1, ALL OTHER SMOKE ALARMS WITHIN THE LANEWAY SUITE SHALL BECOME AUDIBLE AND LIGHT STROBE SHALL ILLUMINATE ON/OFF IN A STROBE LIKE MANNER FOR ALL SMOKE ALARMS.
 3. FURTHER TO POINT 1 AND 2, UPON SMOKE DETECTION BY ANY SMOKE ALARM WITHIN THE LANEWAY SUITE, THE EXTERIOR STROBE LIGHT SHALL ILLUMINATE ON/OFF IN STROBE LIKE MANNER.


FIRE ALARM NOTES

THE SYSTEM MUST CONFORM TO THE LATEST APPLICABLE STANDARDS OF ULC, CSA AND REQUIREMENTS OF THE ONTARIO FIRE CODE (OFC), ONTARIO BUILDING CODE (OBC) AND THE AUTHORITY HAVING JURISDICTION.

1. SMOKE ALARMS ARE REQUIRED TO COMPLY WITH CAN/ULC-S531, "SMOKE ALARMS", AND HAVE VISUAL SIGNALING COMPONENT.
2. SMOKE ALARMS/WARNING SYSTEM MUST HAVE A RESIDENTIAL FIRE WARNING SYSTEM THAT IS INSPECTED, TESTED AND MAINTAINED IN ACCORDANCE WITH CAN/ULC-S540 AND THE APPLICABLE PROVISIONS IN THE ONTARIO FIRE CODE (OFC)
3. THE FIRE ALARM SYSTEM SHALL BE INSTALLED IN ACCORDANCE WITH THE OBC, DIV B, PART 3, SUBSECTION 3.2.4., AND IN CONFORMANCE WITH CAN/ULC-S524, "INSTALLATION OF FIRE ALARM SYSTEMS".
4. THE VERIFICATION OF THE FIRE ALARM SYSTEMS IS REQUIRED PRIOR TO FINAL TESTING AND SHALL BE DONE IN ACCORDANCE WITH CAN/ULC-S537 "THE STANDARD FOR THE VERIFICATION OF FIRE ALARM SYSTEMS"
5. THE FIRE ALARM SOUND PRESSURE LEVELS AND TEMPORAL PATTERNS SHALL CONFIRM TO OBC, DIV. B, PART 3, ARTICLE 3.2.4.18. THE SOUND PRESSURE LEVELS SHALL NOT BE LESS THAN 10dBA ABOVE AMBIENT NOISE AND SHALL BE MINIMUM 65dBA.
6. EMERGENCY POWER SHALL BE PROVIDED FOR FIRE ALARM SYSTEMS, AS PER OBC, DIV. B, PART 3, ARTICLE 3.2.7.8.

NOTE

CONTRACTOR TO INSTALL EXTERIOR STROBE LIGHT ON EXTERIOR SIDE OF THE BUILDING FACING THE LANEWAY.
 -MUST CONFORM TO CAN/ULC-S540, "RESIDENTIAL FIRE AND LIFE SAFETY WARNING SYSTEMS: INSTALLATION, INSPECTION, TESTING AND MAINTENANCE".
 -MUST CONFORM TO CAN/ULC-S526, "VISIBLE SIGNAL DEVICES FOR FIRE ALARM SYSTEMS, INCLUDING ACCESSORIES".
 -THE STROBE IS TO BE RATED FOR EXTERIOR USE AND ACTIVATED BY THE INTERCONNECTED SMOKE ALARMS LOCATED WITHIN THE LANEWAY SUITE.
 -THE STROBE IS TO BE LOCATED AT A MINIMUM HEIGHT OF 1.8M ABOVE THE ADJACENT GROUND LEVEL AND BE VISIBLE FROM THE LANEWAY WITH CONSIDERATION OF OBSTRUCTIONS SUCH AS TREES AND FENCING.
 -A CONTROL PANEL MUST BE INCLUDED AS A PART OF THIS SYSTEM.

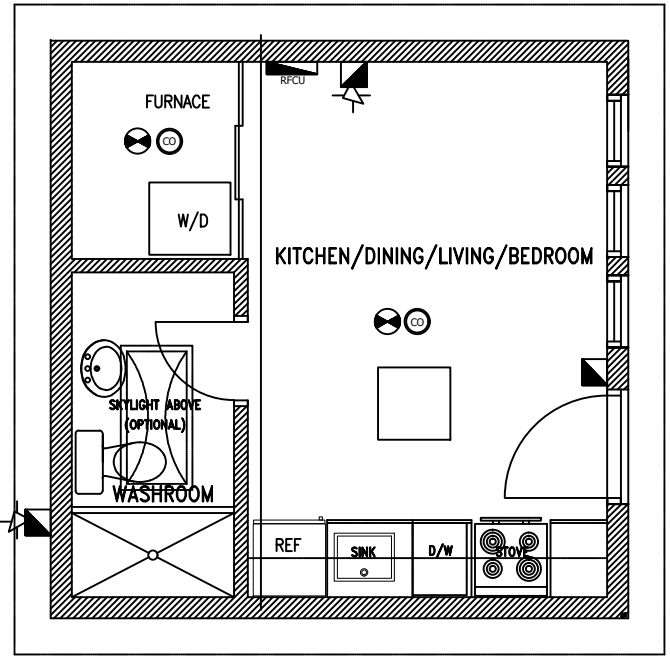

NO.	REVISION	DATE
1	AS PER DIVISION COMMENTS	07/2025
TITLE: FIRE ALARM LAYOUT PRE-APPROVED PLANS		
DATE:	JUNE 2025	DRAWING NO.:
SCALE:	3/16"=1'	FA1